

UL 1693

ISBN 1-55989-861-5

Electric Radiant Heating  
Panels and Heating Panel Sets



Underwriters Laboratories Inc. (UL)  
333 Pfingsten Road  
Northbrook, IL 60062-2096

UL Standard for Safety for Electric Radiant Heating Panels and Heating Panel Sets, UL 1693

First Edition, Dated May 18, 1995

Revisions: This Standard contains revisions through and including May 27, 1999.

Text that has been changed in any manner is marked with a vertical line in the margin. Changes in requirements are marked with a vertical line in the margin and are followed by an effective date note indicating the date of publication or the date on which the changed requirement becomes effective.

The revisions dated May 27, 1999 include a reprinted title page (page1) for this Standard.

As indicated on the title page (page 1), this UL Standard for Safety is an American National Standard. Attention is directed to the note on the title page of this Standard outlining the procedures to be followed to retain the approved text of this ANSI/UL Standard.

The master for this Standard at UL's Northbrook Office is the official document insofar as it relates to a UL service and the compliance of a product with respect to the requirements for that product and service, or if there are questions regarding the accuracy of this Standard.

UL's Standards for Safety are copyrighted by UL. Neither a printed copy of a Standard, nor the distribution diskette for a Standard-on-Diskette and the file for the Standard on the distribution diskette should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

Revisions of UL Standards for Safety are issued from time to time. A UL Standard for Safety is current only if it incorporates the most recently adopted revisions.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

UL will attempt to answer support requests concerning WordPerfect, Envoy, and Standards-on-Diskette. However, this support service is offered on a reasonable efforts basis only, and UL may not be able to resolve every support request. UL supports a Standards-on-Diskette only if it is used under the conditions and operating systems for which it is intended. UL's support policies may change from time-to-time without notification.

UL reserves the right to change the format, presentation, file types and formats, delivery methods and formats, and the like of both its printed and electronic Standards without prior notice.

Standards-on-Diskette purchasers agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgement (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing a Standard-on-Diskette on the purchaser's computer system.

If a single-user version Standards-on-Diskette was purchased, one copy of this Standard may be stored on the hard disk of a single personal computer, or on a single LAN file-server or the permanent storage device of a multiple-user computer in such a manner that this Standard may only be accessed by one user at a time and for which there is no possibility of multiple concurrent access. The original distribution diskette should be stored in a safe place.

If a multiple-user version Standards-on-Diskette was purchased, one copy of the Standard may be stored on a single LAN file-server, or on the permanent storage device of a multiple-user computer. The number of concurrent users shall not exceed the number of users authorized for the Standards-on-Diskette version. The original distribution diskette should be stored in a safe place.

Standards-on-Diskette are intended for on-line use, such as for viewing the requirements of a Standard, conducting a word search, and the like. Only one copy of the Standard may be printed from each single-user version of a Standards-on-Diskette. Only one copy of the Standard may be printed for each authorized user of a multiple-user version of a Standards-on-Diskette. An employee of an organization purchasing a Standard-on-Diskette can make a copy of the page or pages being viewed for their own fair and/or practical internal use. Because of differences in the computer/software/printer setup used by UL and those of Standards-on-Diskette purchasers, the printed copy obtained by a purchaser may not look exactly like the on-line screen view or the printed Standard.

The requirements in this Standard are now in effect, except for those paragraphs, sections, tables, figures, and/or other elements of the Standard having future effective dates as indicated in the note following the affected item. The prior text for requirements that have been revised and that have a future effective date are located after the Standard, and are preceded by a "SUPERSEDED REQUIREMENTS" notice.

New product submittals made prior to a specified future effective date will be judged under all of the requirements in this Standard including those requirements with a specified future effective date, unless the applicant specifically requests that the product be judged under the current requirements. However, if the applicant elects this option, it should be noted that compliance with all the requirements in this Standard will be required as a condition of continued Listing and Follow-Up Services after the effective date, and understanding of this should be signified in writing.

Copyright © 1999 Underwriters Laboratories Inc.

This Standard consists of pages dated as shown in the following checklist:

Page	Date
1.....	May 27, 1999
2.....	December 3, 1997
2A-3.....	May 27, 1999
4-18.....	May 18, 1995
19.....	December 3, 1997
20.....	December 11, 1996
21-22.....	May 18, 1995
23.....	December 11, 1996
24.....	May 18, 1995
25.....	December 3, 1997
26-27.....	December 11, 1996
28-31.....	May 18, 1995
32.....	December 11, 1996
33-36.....	May 18, 1995
37-38.....	December 3, 1997
39-40.....	May 18, 1995
A1-A2.....	May 18, 1995

No Text on This Page

**MAY 18, 1995**  
(Title Page Reprinted: May 27, 1999)

1

**UL 1693**

**Standard for Electric Radiant Heating Panels and Heating Panel Sets**

**First Edition**

**May 18, 1995**

Approval as an American National Standard (ANSI) covers the numbered paragraphs on pages dated May 18, 1995 and May 27, 1999. These pages should not be discarded when revised or additional pages are issued if it is desired to retain the ANSI approved text.

An effective date included as a note immediately following certain requirements is one established by Underwriters Laboratories Inc.

Approved as ANSI/UL 1693-1998, August 3, 1998

Revisions of this Standard will be made by issuing revised or additional pages bearing their date of issue. A UL Standard is current only if it incorporates the most recently adopted revisions, all of which are itemized on the transmittal notice that accompanies the latest set of revised requirements.

**ISBN 1-55989-861-5**

**COPYRIGHT © 1995, 1999 UNDERWRITERS LABORATORIES INC.**

No Text on This Page

## CONTENTS

FOREWORD .....	4
----------------	---

## INTRODUCTION

1 Scope .....	5
2 Glossary .....	6
3 Components .....	7
4 Units of Measurement .....	7
5 References .....	7

## CONSTRUCTION

6 General .....	8
7 Enclosure .....	8
8 Protection Against Corrosion .....	12
9 Supply Connections .....	12
10 Wire Connectors .....	13
11 Electrical Insulation .....	14
12 Thermal Insulation .....	14
13 Flammability .....	15
13.1 General .....	15
13.2 Flexible heating products .....	15
13.3 Rigid heating products with polymeric enclosures .....	15
14 Spacings .....	15
15 Grounding .....	17

## PERFORMANCE

### GENERAL

16 Details .....	18
------------------	----

### ALL HEATING PRODUCTS

17 Power Input Test .....	19
18 General Test Conditions .....	20
19 Normal Temperature Test .....	20
19.1 General .....	20
19.2 Test alcove construction .....	21
19.3 Ceiling installation .....	25
19.4 Floor installation .....	25
19.5 Common ceiling/floor section installation .....	26
19.6 Concrete or poured masonry installations .....	26
19.7 Test procedure .....	26
20 Abnormal Temperature Test .....	29
20.1 Ceiling installation .....	29
21 Contact Loss Test .....	29
21.1 Parallel type heating products .....	29

**FLEXIBLE HEATING PRODUCTS**

22 Dielectric Voltage-Withstand Test (Dry) .....	.30
23 Dielectric Voltage-Withstand Test (In Water) .....	.30
24 Cold Bend Test .....	.31
25 Mechanical Abuse Tests .....	.31
25.1 General .....	.31
25.2 Conditioning .....	.32
26 Scratch Test .....	.32
27 Concrete Slab Cracking Test .....	.33
28 Nonheating Conductor (Busbar) Overload Test .....	.33
28.1 Parallel type flexible heating products intended for feed through connection to other heating products .....	.33

**RIGID HEATING PRODUCTS**

29 Dielectric Voltage-Withstand Test (Dry) .....	.34
30 Dielectric Voltage-Withstand Test (Water) .....	.34
31 Impact Test .....	.35
32 Drop Test .....	.35

**MANUFACTURING AND PRODUCTION TESTS**

33 Production-Line Dielectric Voltage-Withstand Test .....	.36
--	-----

**MARKINGS**

34 Details .....	.37
35 Warning Labels .....	.38

**INSTALLATION INSTRUCTIONS**

36 Details .....	.39
------------------	-----

**APPENDIX A**

Standards for Components.....	A1
-------------------------------	----

No Text on This Page

## FOREWORD

A. This Standard contains basic requirements for products covered by Underwriters Laboratories Inc. (UL) under its Follow-Up Service for this category within the limitations given below and in the Scope section of this Standard. These requirements are based upon sound engineering principles, research, records of tests and field experience, and an appreciation of the problems of manufacture, installation, and use derived from consultation with and information obtained from manufacturers, users, inspection authorities, and others having specialized experience. They are subject to revision as further experience and investigation may show is necessary or desirable.

B. The observance of the requirements of this Standard by a manufacturer is one of the conditions of the continued coverage of the manufacturer's product.

C. A product which complies with the text of this Standard will not necessarily be judged to comply with the Standard if, when examined and tested, it is found to have other features which impair the level of safety contemplated by these requirements.

D. A product employing materials or having forms of construction which conflict with specific requirements of the Standard cannot be judged to comply with the Standard. A product employing materials or having forms of construction not addressed by this Standard may be examined and tested according to the intent of the requirements and, if found to meet the intent of this Standard, may be judged to comply with the Standard.

E. UL, in performing its functions in accordance with its objectives, does not assume or undertake to discharge any responsibility of the manufacturer or any other party. The opinions and findings of UL represent its professional judgment given with due consideration to the necessary limitations of practical operation and state of the art at the time the Standard is processed. UL shall not be responsible to anyone for the use of or reliance upon this Standard by anyone. UL shall not incur any obligation or liability for damages, including consequential damages, arising out of or in connection with the use, interpretation of, or reliance upon this Standard.

F. Many tests required by the Standards of UL are inherently hazardous and adequate safeguards for personnel and property shall be employed in conducting such tests.

## INTRODUCTION

### 1 Scope

\*Section 1 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

1.1 These requirements cover radiant heating panels and heating panel sets, for use on ac supply system voltages not exceeding 600 V, designed for installation indoors in nonhazardous locations in household, commercial, and industrial applications, in accordance with Article 424, Part J, of the National Electrical Code, ANSI/NFPA 70.

1.2 These requirements cover products designed to be permanently connected to a supply circuit, and that are intended to form an integral part of the building construction after on-site assembly, installation, and connection.

1.3 These requirements do not cover the following:

- a) Radiant heating panels intended to be installed in a dropped or suspended ceiling which are covered by the Standard for Fixed and Location-Dedicated Electric Room Heaters, UL 2021;
- b) Heating panels, panel sets, and systems mounted under a floor covering in accordance with Article 424-99 of the National Electrical Code, ANSI/NFPA 70;
- c) Heating cables and cable sets, which are covered by the Standard for Electric Space Heating Cables, UL 1673;
- d) Cord connected and movable heating equipment;
- e) Heating products containing an integral means of producing air flow;
- f) Heating products containing a regulating thermostat as an integral part of the product construction.

1.4 A product that contains features, characteristics, components, materials, or systems new or different from those covered by the requirements in this standard, and that involves a risk of fire, electric shock, or injury to persons shall be evaluated using the appropriate additional component and end-product requirements as determined necessary to maintain the acceptable level of safety as originally anticipated by the intent of this standard. A product whose features, characteristics, components, materials, or systems conflict with specific requirements or provisions of this standard cannot be judged to comply with this standard. Where considered appropriate, revision of requirements shall be proposed and adopted in conformance with the methods employed for development, revision, and implementation of this standard.

## 2 Glossary

\*Section 2 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

2.1 For the purpose of this Standard, the following definitions apply.

2.2 ACTIVE AREA – That part of a heating product forming a plane area bounded by the perimeter of the heating element and its non-heating components.

2.3 ASSOCIATE PART – A nonintegral part of a heating product essential for the correct operation, installation, or both, of the product.

2.4 FLEXIBLE HEATING PRODUCT – A heating product of nonrigid construction, composed of thin flexible sheets of electrical insulating material enclosing a heating element, which is intended for installation in contact with normal building construction materials.

2.5 HEATING ELEMENT – That portion of a heating panel or heating panel set that is the actual electrical conducting medium, including a continuously applied or patterned conductive film, intended to be heated by an electric current.

2.6 HEATING PANEL – A complete assembly provided with a junction box or a length of flexible conduit for connection to a branch circuit.

2.7 HEATING PANEL SET – An assembly provided with nonheating leads or a terminal junction assembly identified as being suitable for connection to a wiring system. It may be of fixed dimension, or of continuous form where the final product dimension is determined during installation.

2.8 HEATING PRODUCT – A collective term used to refer to heating panels and heating panel sets.

2.9 NONHEATING COMPONENT – A component of a heating product that carries current or is conductively coupled to a supply circuit, and that is not primarily intended to produce heat.

2.10 NONHEATING LEADS – Lead wires provided to facilitate connection of a heating product directly to branch circuit conductors. Also known as "cold leads."

2.11 RIGID HEATING PRODUCT – A heating product of fixed construction designed to be mounted on or above a ceiling, forming all or part of a ceiling, or mounted below a subfloor.

2.12 TERMINAL BOX – A box or enclosure, inside which connections between branch circuit conductors and cold leads or terminals are made.

### 3 Components

\*Section 3 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

3.1 Except as indicated in 3.2, a component of a product covered by this standard shall comply with the requirements for that component. See Appendix A for a list of Standards covering components generally used in the products covered by this Standard.

A component need not comply with a specific requirement that:

- a) Involves a feature or characteristic not needed in the application of the component in the product covered by this standard, or
- b) Is superseded by a requirement in this standard.

3.3 A component shall be used in accordance with its recognized rating established for the intended conditions of use.

3.4 Specific components are recognized as being incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions for which they have been recognized.

### 4 Units of Measurement

\*Section 4 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

4.1 If a value for measurement is followed by a value in other units in parentheses, the second value may be only approximate. The first stated value is the requirement.

### 5 References

\*Section 5 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

5.1 Any undated reference to a code or standard appearing in the requirements of this standard shall be interpreted as referring to the latest edition of that code or standard.

## CONSTRUCTION

### 6 General

\*Section 6 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

6.1 A heating product shall be provided with means for mounting in the intended manner. Any fittings – such as brackets, hangers, or the like – necessary for mounting shall be furnished with the heating product.

6.2 A heating product intended to be installed in contact with combustible building construction materials, such as furring, nailing strips or joists shall be provided with an integral means to facilitate securement during installation.

6.3 A heating product shall be installed in accordance with the manufacturer's installation instructions provided with the heating product. See Details, Section 36.

### 7 Enclosure

\*Section 7 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

7.1 The enclosure of a heating product shall be so formed and assembled that it will have the strength and rigidity necessary to resist the abuses likely to be encountered during its intended service. The degree of resistance inherent in the heating product shall preclude total or partial collapse with the attendant reduction of spacings, loosening or displacement of parts, and other serious defects which alone or in combination constitute a risk of fire, electric shock, explosion, or injury to persons.

*Exception: A heating product need not be rigid if, when installed per the manufacturer's instructions, the building construction materials completely enclose the product except for the nonheating leads.*

7.2 Among the factors taken into consideration if an enclosure is being judged for acceptability are its mechanical strength, resistance to impact, moisture-absorption properties, flammability, resistance to corrosion, and resistance to distortion and or delamination at temperatures to which the enclosure may be subjected under conditions of intended or abnormal use.

7.3 Cast- and sheet-metal portions of the enclosure shall not be thinner than indicated in Table 7.1 unless the enclosure is found to be acceptable when judged under considerations such as are mentioned in 7.4.

7.4 An enclosure of sheet metal is to be judged with respect to its size and shape, the thickness of metal, and its acceptability for the particular application, considering the intended use of the heating product.

7.5 Sheet metal to which a wiring system is to be connected in the field shall have an average thickness not less than 0.81 mm (0.032 inch) if uncoated steel, not less than 0.86 mm (0.034 inch) if galvanized steel, and not less than 1.14 mm (0.045 inch) if nonferrous.

7.6 An electrical part of a heating product, installed in accordance with the manufacturer's installation instructions, shall be so located or enclosed to provide protection against unintentional contact with uninsulated live parts.

7.7 Determination of the acceptability of a polymeric material used as an enclosure of a rigid heating product shall be made based on the Standard for Polymeric Materials – Use in Electrical Equipment Evaluations, UL 746C.

7.8 The flexible enclosure material of a flexible heating product shall have a relative thermal index and adhesive bond strength suitable for the temperatures to which it is exposed during the Normal and Abnormal Temperature Tests and shall comply with the requirements in Flammability, Section 13. Determination of the acceptability of a polymeric material used as an enclosure of a flexible heating product with respect to its relative thermal index and adhesive bond strength shall be made based on the requirements of UL 746C.

**Table 7.1**  
**Minimum acceptable thickness of enclosure metal**

Metal	At small, flat, unreinforced surfaces and at surfaces that are reinforced by curving, ribbing and the like (or are otherwise of a shape and/or size) to provide mechanical strength		At relatively-large unreinforced flat surfaces	
	Millimeters	(Inches)	Millimeters	(Inches)
Die-cast	1.2	(3/64)	2.0	(5/64)
Cast malleable	1.6	(1/16)	2.4	(3/32)
Other cast metal	2.4	(3/32)	3.2	(1/8)
Uncoated sheet steel	0.66 <sup>a</sup>	(0.026) <sup>a</sup>	-	-
Galvanized sheet steel	0.74 <sup>a</sup>	(0.029) <sup>a</sup>	-	-
Nonferrous sheet metal	0.91 <sup>a</sup>	(0.036) <sup>a</sup>	-	-

<sup>a</sup> Thinner sheet metal may be employed if found to be acceptable when the enclosure is judged under considerations such as those mentioned in 7.4.

7.9 See Wire Connectors, Section 10, for requirements for insulating covers for wire connectors and pre-insulated wire connectors.

7.10 To reduce the likelihood of unintentional contact that may involve a risk of electric shock from an uninsulated live part, an opening in an enclosure shall comply with one of the following:

- a) For an opening that has a minor dimension (see 7.12) less than 25.4 mm (1 inch), such a part or wire shall not be contacted by the probe illustrated in Figure 7.1.
- b) For an opening that has a minor dimension of 25.4 mm (1 inch) or more, such a part or wire shall be spaced from the opening as specified in Table 7.2.

**Table 7.2**

**Minimum acceptable distance from an opening to a part that may involve a risk of electric shock**


Minor dimension of opening <sup>a</sup>		Minimum distance from opening to part	
Millimeters <sup>b</sup>	(Inches) <sup>b</sup>	Millimeters <sup>b</sup>	(Inches) <sup>b</sup>
19.1	(3/4)	114.0	(4-1/2)
25.4	(1)	165.0	(6-1/2)
31.8	(1-1/4)	190.0	(7-1/2)
38.1	(1-1/2)	318.0	(12-1/2)
47.6	(1-7/8)	394.0	(15-1/2)
54.0	(2-1/8)	444.0	(17-1/2)
c	c	762.0	(30)

<sup>a</sup> See 7.12.  
<sup>b</sup> Between 19.1 mm (3/4 inch) and 54 mm (2-1/8 inches), interpolation is to be used to determine a value between values specified in the Table.  
<sup>c</sup> More than 54 mm (2-1/8 inches), but not more than 152 mm (6 inches).

7.11 The probe illustrated in Figure 7.1 shall be used as a measuring instrument to judge the accessibility provided by an opening, and not as an instrument to judge the strength of a material; it shall be applied with the minimum force necessary to determine accessibility.

7.12 With reference to the requirements in 7.10, the minor dimension of an opening is the diameter of the largest cylindrical probe having a hemispherical tip that can be inserted through the opening.

Figure 7.1  
Articulate probe with web stop

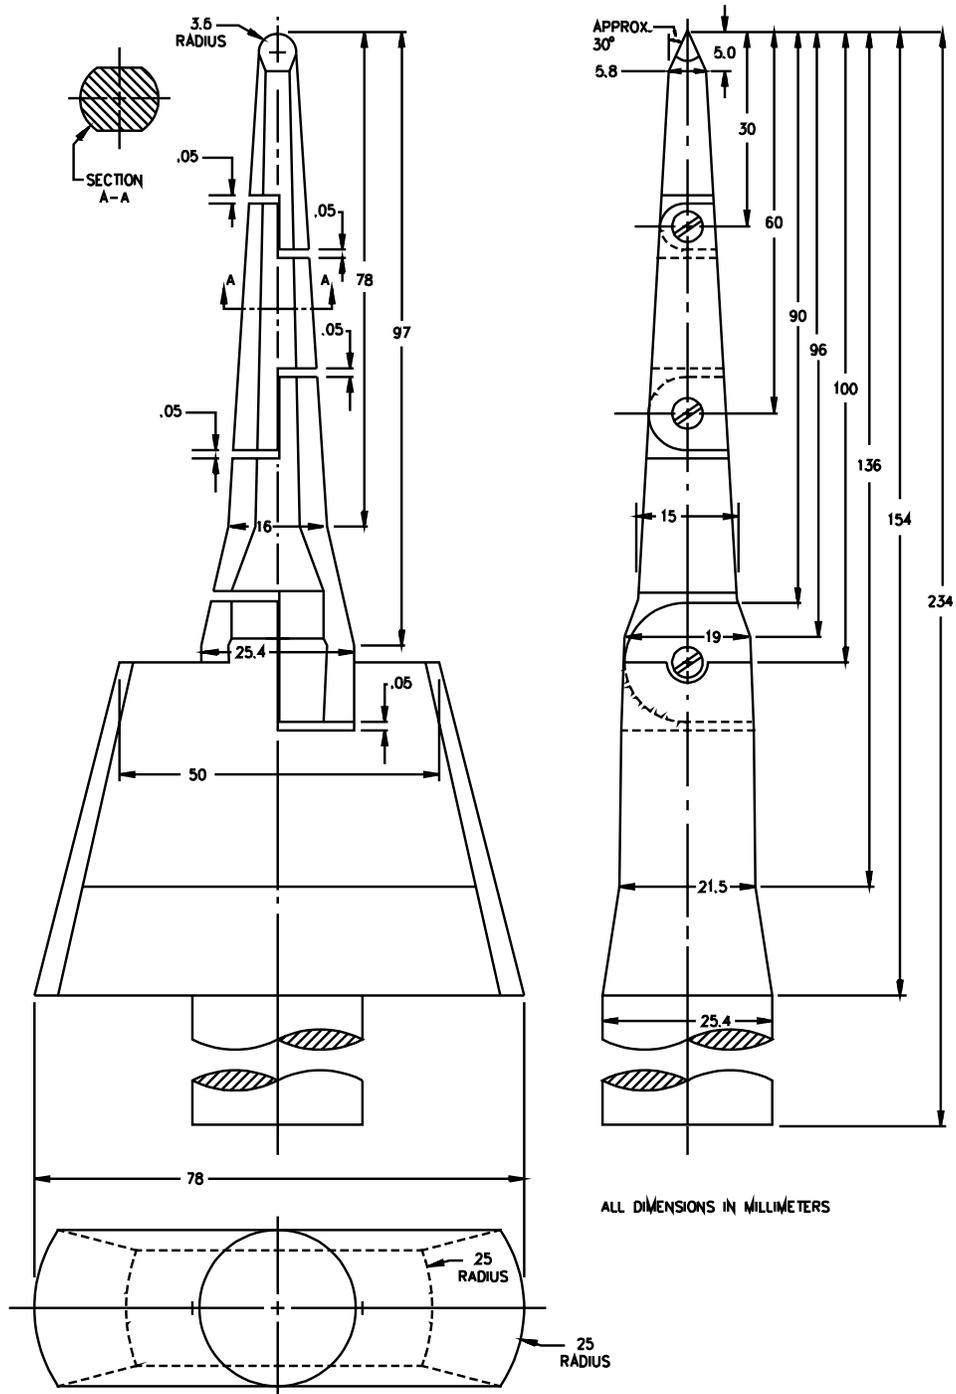

PA100A

## 8 Protection Against Corrosion

\*Section 8 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

8.1 Except as noted in 8.2, iron and steel parts shall be protected against corrosion by enameling, galvanizing, plating, or other equivalent means if the deterioration of such unprotected parts would be likely to result in risk of fire, electric shock, explosion, or personal injury.

8.2 In certain equipment where the oxidation of steel is not likely to be accelerated due to the exposure of metal to air and moisture or other oxidizing influence – thickness of metal and temperature also being factors – surfaces of sheet steel within an enclosure may not be required to be protected against corrosion. Cast-iron parts are not required to be protected against corrosion. A sheath employed on a heating element operating in air and terminal parts attached directly to the heating element need not be protected against corrosion.

8.3 The aging characteristics of plating or other finish used in a heating product shall be such that deterioration of the finish will not result in unacceptable performance of the heating product.

## 9 Supply Connections

\*Section 9 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

9.1 Each heating product shall have provision for permanent connection to a supply circuit.

9.2 For a heating product with supply connections concealed by building construction materials after installation, the means of supply circuit connection shall be one of the following:

- a) Integral nonheating leads complying with the requirements of 9.4;
- b) Field assembled nonheating leads complying with the requirements of 9.4, including the means of connection to the heating product complying with the requirements of Wire Connectors, Section 10; or
- c) Terminal fittings complying with the requirements of Wire Connectors, Section 10.

9.3 For a surface mounted heating product, and a heating product intended for installation in which the supply conductors are not intended to be concealed by building construction materials after installation, the means of supply circuit connection shall be one of the following:

- a) Terminals suitable for connection of branch circuit conductors, marked to indicate the intended supply circuit connection, and located inside a terminal box; or
- b) Pigtail leads, marked to indicate the intended supply circuit connection, and located inside a terminal box or as part of a length of flexible conduit.

9.4 Nonheating leads of heating products shall be suitable for the applied voltage and the temperature to which they are subjected under normal and abnormal operating conditions, and shall be one of the following:

- a) Nonmetallic sheathed cable (Types NM and NMC) or the equivalent if:
  - 1) Not enclosed in a terminal box or enclosure; or
  - 2) Intended to be installed in direct contact with combustible building materials;
- b) Appliance wiring material if the wiring is internal to the product such as conductors used for making supply connections inside a terminal box; or
- c) Underground feeder and branch circuit cable (Type UF) or mineral insulated, metal sheathed cable (Type MI) for single conductor applications as specified in (a).

9.5 Factory-assembled nonheating leads shall be one of the following:

- a) Not less than 1 m (3 ft) long, for heating products designed to have supply circuit connections located remote from the product;
- b) Not less than 152 mm (6 inches) long, for heating panels where supply circuit connections are made in an integral terminal box.

9.6 The location of a terminal box or compartment, if provided, in which power-supply connections are to be made shall be such that these connections may be inspected after the heating product is installed as intended, before the surface finishing material (floor or ceiling) is applied.

9.7 A terminal box or compartment shall not be permitted to rotate such that wiring and connections are subjected to stress or mechanical abuse.

9.8 The surface of an insulated lead intended for the connection of an equipment-grounding conductor shall be green with or without one or more yellow stripes, and no other lead shall be so identified.

## 10 Wire Connectors

\*Section 10 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

10.1 Wire connectors, recommended by a heating product manufacturer for the attachment of nonheating leads to a heating product, shall be of a nonreusable type, and shall comply with the requirements of the Standard for Equipment Wiring Terminals for Use With Aluminum and/or Copper Conductors, UL 486E.

10.2 Wire connectors not intended to be enclosed in a terminal box shall be provided with an insulating cover to reduce the likelihood of contact with uninsulated live parts after correct assembly.

10.3 Insulating covers as described in 10.2 shall comply with the Standard for Polymeric Materials – Use in Electrical Equipment Evaluations, UL 746C.

*Exception: Small parts, measuring a maximum of 60 mm long, 25 mm wide and 15 mm thick need not comply with the flammability requirements of UL 746C provided that the insulating material has a minimum flame class rating of 94V-0 in accordance with the requirements of the Standard for Tests for Flammability of Plastic Materials for Parts in Devices and Appliances, UL 94 .*

10.4 Insulating covers shall be free of sharp edges at all points of contact with an element.

10.5 When a special tool is required for the installation of wire connectors to connect nonheating leads to a heating product, the tool shall be identified by manufacturer name or trade name, part number and any limitations (number of wires to be connected, AWG size, and the like) in the heating product installation instructions. See 36.2(i).

## 11 Electrical Insulation

\*Section 11 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

11.1 Insulating washers, bushings, and the like, that are integral parts of a heating product, and bases or supports for the mounting of live parts shall be of a moisture-resistant material that will not be damaged by the temperatures to which they will be subjected under conditions of actual use. Molded parts shall be constructed so that they will have the mechanical strength and rigidity necessary to withstand the stresses of actual service.

11.2 Insulating material employed in a heating product is to be judged with respect to its particular application. Materials such as mica, some molded compounds, and certain refractory materials are usually acceptable for use as the sole support of live parts. Other materials that are not for general use, such as magnesium oxide, may be acceptable if used in conjunction with other less hygroscopic insulating materials or if located and protected so that they are not subjected to mechanical damage and are resistant to the absorption of moisture. When it is necessary to investigate a material to determine whether or not it is acceptable, consideration is to be given to its mechanical strength, dielectric properties, insulation resistance, heat-resistant qualities, the degree to which it is enclosed or protected and any other features having a bearing on the likelihood that a risk of fire, electric shock, or injury to persons may occur, under conditions of actual service. All of these factors are considered with respect to thermal aging.

11.3 In the mounting or supporting of small, fragile, insulating parts, screws or other fastenings shall not be tight enough to cause cracking or breaking of these parts with expansion and contraction. Generally, such parts should be slightly loose.

## 12 Thermal Insulation

\*Section 12 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

12.1 Thermal insulation shall be of such nature and located and mounted or supported so that it will not be adversely affected by any intended operation of the heating product.

12.2 Thermal insulation that is not rigid shall be mounted or supported so that it will not sag. Adhesive material employed for mounting thermal insulation shall be acceptable for use at the temperature to which it may be subjected.

12.3 Determination of the acceptability of an adhesive may be omitted if the thermal insulation is mechanically supported by at least 11 rivets or the equivalent per square meter of material (at least one rivet or the equivalent per square foot of material).

12.4 Flammable or electrically conductive thermal insulation shall not contact uninsulated live parts of a heating product.

12.5 Some types of mineral-wool thermal insulation contain conductive impurities in the form of slag that make its use unacceptable if in contact with uninsulated live parts.

### **13 Flammability**

\*Section 13 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

#### **13.1 General**

13.1.1 These requirements apply to:

- a) All flexible heating products; and
- b) All rigid heating products having polymeric enclosures.

#### **13.2 Flexible heating products**

13.2.1 A flexible heating product intended to be installed in direct contact with combustible building construction materials and forming an integral part of the building construction shall have a minimum flame rating of 94-HB in accordance with the requirements of the Standard for Tests for Flammability of Plastic Materials for Parts in Devices and Appliances, UL 94.

#### **13.3 Rigid heating products with polymeric enclosures**

13.3.1 A polymeric enclosure of a rigid heating product shall have a flame rating of 94-5V in accordance with the requirements of the Standard for Tests for Flammability of Plastic Materials for Parts in Devices and Appliances, UL 94 .

### **14 Spacings**

\*Section 14 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

14.1 The spacings in a heating product shall be in accordance with Tables 14.1 and 14.2.

**Table 14.1**  
**Minimum acceptable spacings at field-wiring terminals <sup>a,b</sup>**

Parts involved	Potential involved	Through air		Over surface	
		mm	(Inch)	mm	(Inch)
Between live parts of opposite polarity; and between a live part and a noncurrent carrying metal part, which may be grounded	0 – 250 volts	6.4	(1/4)	9.5	(3/8)
	251 – 600	9.5	(3/8)	12.7	(1/2)

<sup>a</sup> The spacings do not apply to connecting straps or busses extending away from wiring terminals. Such spacings are to be judged under 14.2.  
<sup>b</sup> Applies to the sum of the spacings involved where an isolated noncurrent carrying part is interposed.

**Table 14.2**  
**Minimum acceptable spacings through air or over surface at points other than field-wiring terminals<sup>a</sup>**

Parts involved	Potential involved, volts	Millimeters	(Inch)
Between uninsulated live parts of opposite polarity; and between a rigidly mounted uninsulated live part and a noncurrent-carrying metal part that either is exposed for persons to contact or may be grounded.	0 – 250	1.6	(1/16)
	251 – 600	6.4 <sup>b</sup>	(1/4) <sup>b</sup>

<sup>a</sup> If an uninsulated live part is not rigidly supported, or if a movable noncurrent-carrying metal part is in proximity to an uninsulated live part, the construction shall be such that at least the minimum acceptable spacing of 1.6 mm (1/16 inch) is maintained under all operating conditions and under all normal conditions of handling.  
<sup>b</sup> A spacing of 1.6 mm (1/16 inch) is permissible at the heating element support and terminals only in a heating product rated for 300 volts or less.

14.2 Except as indicated in 14.3, an insulating lining or barrier of fiber or similar material employed where spacings would otherwise be less than the required values shall not be less than 0.8 mm (1/32 inch) thick and shall be so located or of such material that it will not be affected adversely by arcing; except that fiber not less than 0.4 mm (1/64 inch) thick may be used in conjunction with an air spacing of not less than 50 percent of the spacing required for air alone.

14.3 Insulating material having a thickness less than that specified in 14.2 may be used if, upon investigation, it is found to be acceptable for the application.

14.4 Unless protected from physical abuse during assembly and operation of the heating product, a barrier of mica shall be at least 0.25 mm (0.01 inch) thick.

## 15 Grounding

\*Section 15 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

15.1 In a heating product, all exposed dead metal parts and all dead metal parts inside the enclosure that are exposed to contact during any servicing operation (including maintenance and repair) and that are likely to become energized shall be electrically connected to the equipment-grounding terminal or lead or be conductively connected to the point of attachment of the wiring system.

15.2 In a heating product required to be grounded and intended for permanent connection to the power supply by means other than a metal-enclosed wiring system (such as nonmetallic-sheathed cable):

- a) An equipment-grounding terminal or lead shall be provided (see 9.8), and
- b) All exposed noncurrent-carrying metal parts and all noncurrent-carrying metal parts inside the enclosure that are exposed to contact during any servicing operation (including maintenance and repair) and that are likely to become energized shall be conductively connected to such terminal or lead.

15.3 The resistance of the grounding path between a dead metal part and the equipment-grounding terminal and point of attachment of the wiring system shall not be more than 0.1 ohm.

15.4 With reference to 15.3, the resistance may be determined by any convenient method except that if unacceptable results are recorded, either a direct or alternating current equal to the current rating of the maximum-current-rated branch-circuit overcurrent-protective device that may be employed with the heating product is to be passed from the equipment grounding terminal or the point of attachment of the wiring system to the dead metal part, and the resulting drop in potential is measured between these two points. The resistance in ohms is to be determined by dividing the drop in potential in volts by the current in amperes passing between the two points.

## PERFORMANCE

### GENERAL

#### 16 Details

\*Section 16 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

16.1 See Table 16.1 for a list of tests applicable to flexible and rigid heating products.

**Table 16.1**  
**Performance tests**

Performance test	Section no.	
	Flexible heating products	Rigid heating products
Power Input	17	17
Normal Temperature	19	19
Abnormal Temperature	20	20
Contact Loss	21	21
Dielectric Voltage-Withstand (Dry)	22	29
Dielectric Voltage-Withstand (In-Water)	23	30
Cold Bend	24	-
Mechanical Abuse Test	25	-
Scratch	26	-
Concrete Slab Cracking	27	-
Nonheating Conductor Overload	28	-
Impact	-	31
Drop	-	32

16.2 Each representative heating product is to be subjected to the sequence of heat cycling described in 16.2.1 until the change in resistance, between consecutive heating cycles as noted, is determined to be less than 0.5% as determined in accordance with 16.2.2.

\*16.2 revised and separated into 16.2, 16.2.1, and 16.2.2 December 3, 1997\*

16.2.1 Each representative flexible heating product, cut to size in accordance with the requirements for the Normal Temperature Test, 19.1.1, is to be placed in an air-circulating oven which is initially maintained at a temperature of  $20 \pm 2^\circ\text{C}$ . The total element resistance of each heating product is to be measured after an initial temperature stabilization period. The temperature in the oven is then to be raised for approximately 20 minutes to  $85^\circ\text{C}$  and maintained within  $\pm 5^\circ\text{C}$  for 10 minutes. The heating product is then to be allowed to cool down for 20 minutes, forced cooling is permitted, to a temperature of  $30 \pm 2^\circ\text{C}$  and maintained within  $\pm 2^\circ\text{C}$  for 10 minutes.

\*16.2.1 relocated and revised from 16.2 December 3, 1997\*

16.2.2 The resistance of each heating product is to be measured after the 25th cycle. If the change in resistance between the initial measurement and after the 25th cycle is not less than 0.5%, the resistance measurement is to be repeated after the 400th cycle, and again after every additional 100 cycles until the resistance measured after the current cycle interval differs from the previous cycle interval by less than 0.5%

\*16.2.1 relocated and revised from 16.2 December 3, 1997\*

16.3 Whenever cheesecloth is mentioned, the cloth is to be bleached, 914 mm (36 inches) wide, running 20 – 30 mKg/mass (14 – 15 yards per pound mass) and having what is known to the trade as a "count of 32 x 28", that is, for any square inch, 32 threads in one direction and 28 threads in the other direction (for any square centimeter, 13 threads in one direction and 11 threads in the other direction).

## ALL HEATING PRODUCTS

### 17 Power Input Test

Section 17 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products

17.1 When a heating product is tested as described in 17.2, the measured power input or current input (or both) shall not vary from the marked rating of the product by more than +5% and -10%.

17.2 The product under investigation, a flexible heating product previously conditioned as described in 16.2 or a previously untested rigid heating product, is to be installed in accordance with the instructions specified for the Normal Temperature Test, based on the type of installation, 19.3 – 19.5. The product is to be operated in accordance with the test procedure of the Normal Temperature Test, described in 19.7, except for the supply voltage, which is to be adjusted to the rated voltage of the product. When thermal equilibrium is reached, the input power or current (or both) of the product is to be measured according to the parameters used to rate the product.

## 18 General Test Conditions

Section 18 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products

18.1 The supply voltage feeding the representative heating products during the Normal and Abnormal Temperature Tests is to be adjusted to produce a power input in accordance with the following formula:

$$W_t = 1.05W_m \left( \frac{V_{n \max}}{V_r} \right)^2$$

*in which:*

*1.05 = upper limit tolerance of rated power; see 17.1*

*W<sub>t</sub> = test power (in watts)*

*W<sub>m</sub> = marked power rating of product (at rated voltage); replace with calculated wattage (rated voltage multiplied by rated current) if heating product is rated in amperes*

*V<sub>n max</sub> = upper limit of voltage range for the nominal supply system on which the product is intended to be used; see 34.3*

*V<sub>r</sub> = rated voltage marked on the product under investigation*

18.2 Power adjustment is to be made, if necessary, after the addition of a load to simulate full heating product length as described in 18.3.

18.3 When the length of a representative parallel heating product is less than the maximum length specified by the manufacturer, an additional load is to be connected to the heating product to simulate the maximum specified product length. The additional load is to be connected so that the total load current (product plus added load) flows through the internal nonheating conductors of the product. When a temperature test involves more than one heating product, each product used for the test is to be loaded to simulate maximum length.

18.4 The supply voltage for the Contact Loss Test, Section 21, and the Mechanical Abuse Tests, Section 25, is to be the rated voltage or the upper limit of the voltage range of the nominal supply system on which the product is intended to be used, whichever is greater. See 34.3.

18.4 added December 11, 1996

## 19 Normal Temperature Test

Section 19 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products

### 19.1 General

19.1.1 Each heating product is to be provided in the maximum length or branch circuit size specified by the manufacturer.

*Exception: A combination of heating product and supplemental load in accordance with 18.2 may be provided.*

19.1.2 Unless otherwise specified by the manufacturer, the heating product is to be connected to a 20 A branch circuit using No. 12 AWG (3.3 mm<sup>2</sup>), two conductor nonmetallic sheathed cable, Type NM, nonheating leads. See 36.2(f).

19.1.3 Each heating product is to be installed as close to the corner of the test alcove as construction and product installation instructions permit.

*Exception: Heating products intended to be installed in concrete or poured masonry are not required to be installed in a test alcove.*

19.1.4 Each heating product is to be installed with a vapor barrier in accordance with the manufacturer's installation instructions. If the position of a vapor barrier is not specified in the instructions, the product shall be installed with a vapor barrier in the most adverse position with respect to temperature.

## 19.2 Test alcove construction

19.2.1 For heating products intended to be installed in the ceiling, a test alcove is to be constructed as follows:


a) The ceiling is to be constructed from nominal 2- by 6-inch trade size (38- by 140-mm) softwood lumber, arranged horizontally, with nominal 16 inches (406 mm) on center spacing unless otherwise specified by the heating product manufacturer. See Figure 19.1. If the manufacturer's instructions permit installation of heating products in sloped ceilings, an additional test ceiling with a pitch of 1/2 shall be constructed in accordance with the manufacturer's instructions; and

*Exception: An additional test with a sloped ceiling is not required if, during the Normal Temperature Test of a horizontal ceiling installation, the maximum temperatures of Table 19.1 are not exceeded and the maximum temperature of wood (item 4 of Table 19.1) does not exceed 85°C (185°F).*

b) The wall sections are to be a minimum of 1.5 m (4.9 ft) high, of wood frame construction, consisting of nominal 2- by 4-inch trade size (38- by 89-mm) softwood lumber located on nominal 16 inch (406 mm) centers suitable to support the test ceiling, and covered with 3/8 inch (9.5 mm) thick plywood painted flat black.

**Figure 19.1**  
**Test alcove ceiling construction**

2 X 6 in (38 X 140 mm) Joists

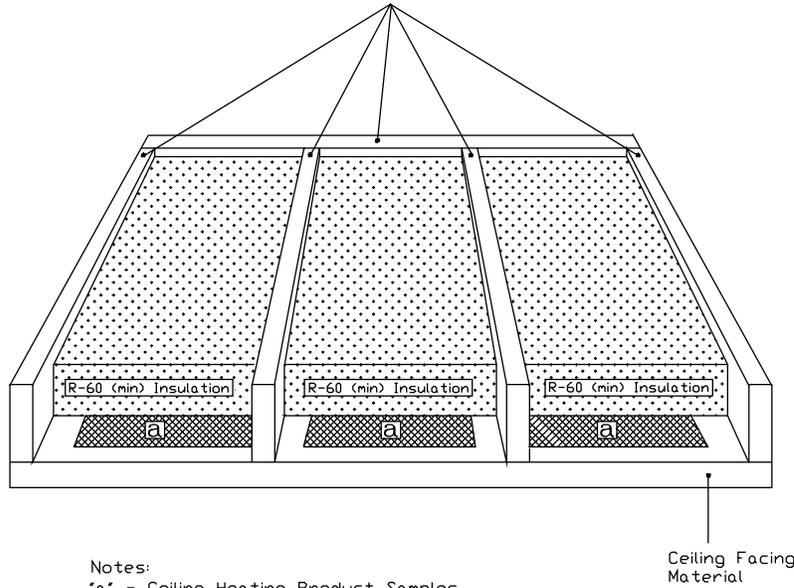

Notes:  
"a" - Ceiling Heating Product Samples


Not to Scale  
SM955E

19.2.2 For heating products intended to be installed in the floor, a test alcove is to be constructed as follows:

- a) The floor is to be constructed from nominal 2- by 8-inch trade size (38- by 184-mm) softwood lumber, with nominal 16 inches (406 mm) on center spacing unless otherwise specified by the manufacturer. A subfloor of 1/2 inch (13 mm) thick plywood is to be provided on the upper surface of the floor construction. The underside of the floor construction shall be covered by 1/2 inch (13 mm) thick gypsum board. Both the floor joists and the subfloor are to be painted flat black. See Figure 19.2; and
- b) The wall sections are to be constructed as described in 19.2.1(b).


**Figure 19.2**  
**Test alcove floor construction**

Figure 19.2 revised December 11, 1996

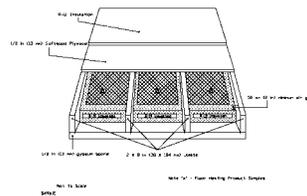

19.2.3 For heating products intended to be installed in a common ceiling/floor section, the test alcove is to be constructed as described for the floor construction in 19.2.2, except that the underside is to be covered with a material as specified by the manufacturer. The upper wall section in the test alcove is to be positioned directly above the lower wall section and all wall surfaces facing the inside of the test alcove are to be painted flat black. See Figure 19.3.

**Figure 19.3**  
**Test alcove common ceiling/floor construction**

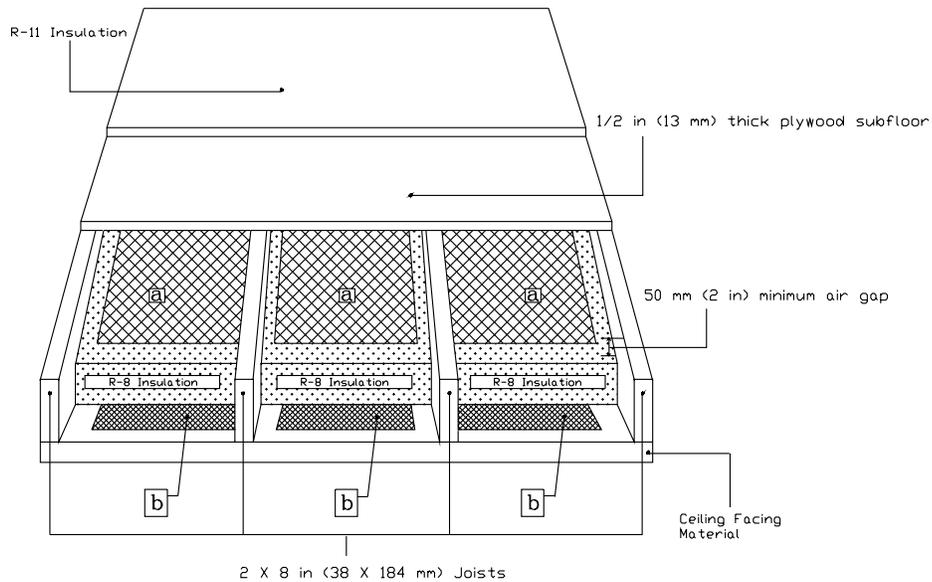

Notes:  
 "a" - Floor Heating Product Samples  
 "b" - Ceiling Heating Product Samples

Not to Scale  
 SM962D

19.2.4 For products intended to be installed on furring or nailing strips, the 2- by 6-inch (38- by 140-mm) joist spacing is to be a nominal 16 inches (406 mm) on center. Joists are to be of suitable length to accommodate representative heating products.

### 19.3 Ceiling installation

19.3.1 When evaluating heating panels, three representative heating panels are to be installed in the ceiling of the test alcove, separated by the minimum distance specified by the product manufacturer, without alteration of the product dimensions. If no separation distance is specified by the product manufacturer, the heating panel sets are to be positioned adjacent to each other.

19.3.2 When evaluating heating panel sets, three lengths of representative heating panel sets are to be installed in the ceiling of the test alcove, separated by the minimum distance specified by the product manufacturer, and are to have an area of at least  $4 \text{ m}^2$  (43.1  $\text{ft}^2$ ) with no lengthwise dimension less than 1.5 m (4.9 ft). If no separation distance is specified by the product manufacturer, the heating panels are to be positioned adjacent to each other.

19.3.3 The heating products are to be covered from below with ceiling facing materials as recommended by the manufacturer of the product under test. Where more than one type of ceiling facing material is recommended, the material having the maximum overall thermal resistance is to be used.

19.3.4 The installed heating products are to be covered from above with thermal insulation at the maximum thermal resistance rating recommended by the product manufacturer, but not less than R-60. Additional insulation shall be provided between furring or nailing strips as recommended by the heating product manufacturer. Unless otherwise specified by the manufacturer, fiberglass batt insulation is to be used.

19.3.5 For surface mounted ceiling installations, the heating products are to be mounted to the underside of the ceiling of the test alcove. Thermal insulation having not less than R-60 rating is to be placed on top of the total finished ceiling area in order to cover the total alcove area, according to the instructions provided by the manufacturer.

### 19.4 Floor installation

19.4.1 The number and relative positioning of the representative heating products installed in the floor of the test alcove is to be the same as described for ceiling installations described in 19.3.1 and 19.3.2.

19.4.2 Thermal insulation of the maximum thermal resistance value specified by the manufacturer, but not less than R-19 is to be installed below the heating products. Floor finishing materials of the maximum thermal resistance value specified by the product manufacturer, but in no case less than R-11 (excluding the subfloor), are to be installed above the subfloor for a portion of the test procedure. The floor finishing material shall provide complete coverage of the joist cavities containing heating panels with the exception of a maximum 406 mm (16 inch) border permitted along the alcove walls. See 19.7.4.

19.4.2 revised December 3, 1997

19.4.3 The air gap between the subfloor and the heating products is to be adjusted as specified by the manufacturer, but shall not be less than 50 mm (2 inches).

## 19.5 Common ceiling/floor section installation

19.5.1 Three representative ceiling heating products and three floor heating products are to be installed to concurrently heat the common ceiling/floor section of the test alcove. The heating products are to be separated horizontally by the minimum distance and vertically by the minimum distance using insulating materials specified by the product manufacturer, without altering the product dimensions. If no separation distances or materials are specified by the product manufacturer, the heating products are to be installed in a common joist space.

19.5.2 Heating products intended for use with other products in the same joist space are to be tested with products of equal power density ratings (watts per unit area) in the floor and ceiling heating positions, unless complimentary products of different power density rating (greater or lower) are specified in the installation instructions provided by the heating product manufacturer. When a heating product manufacturer provides specifications for complimentary heating products, representative heating products of the highest power density are to be used.

19.5.3 Thermal insulation is to be placed in between the ceiling heating products and the floor heating products according to the installation instructions specified by the manufacturer but shall not have more than a R-8 rating.

19.5.4 The ceiling heating products are to be covered from below with ceiling facing materials as recommended by the manufacturer for the product under test. Where more than one type of facing material is recommended, the material type having the maximum overall thermal resistance is to be used.

19.5.5 The floor heating products are to be installed according to the manufacturer's instructions for the air gap between the heating product and the underside of the subfloor, but the gap shall not be less than 50 mm (2 inches).

## 19.6 Concrete or poured masonry installations

19.6.1 A representative heating product shall be installed in or beneath a concrete floor slab in accordance with the manufacturer's instructions. The slab shall have nominal dimensions of 610- by 1220-mm (2- by 4-ft) by 89 mm (3-1/2 inches) thick.

19.6.1 revised December 11, 1996

19.6.2 If the installation is beneath the slab, the heating product shall be placed on a sand base and vapor barrier as specified by the manufacturer.

19.6.3 If the installation is in the slab, a double-pour installation, the heating product shall be installed on a concrete base with a nominal 51 mm (2 inches) of concrete poured over the product. The manufacturer's instructions concerning concrete reinforcement shall be followed. A control joint of nominal 3 mm (1/8 inch) depth shall be formed across the width of the slab, equally spaced between the two ends of the slab. The manufacturer's recommendations regarding slab perimeter insulation shall be followed.

## 19.7 Test procedure

19.7.1 The maximum ambient-adjusted temperature at each sensing location shall not exceed the limits specified in Table 19.1. Temperatures measured in the active area of the heating product shall not vary from each other by more than 5°C (9°F).

**Table 19.1**  
**Maximum temperatures of heating products**

Item	Location	Maximum Temperature	
		°C	°F
1	Any point within a terminal box or wiring compartment of a heating product in which field-installed conductors are to be connected (including such conductors themselves)	60	140
2	On a heating product surface, intended to be installed in contact with combustible building materials	90	194
3	On internal product components not intended to be in contact with combustible building materials	or the temperature rating of the product, whichever is lower The limiting temperature for the materials used	
4	On wood	90	194
5	On gypsum board used as a facing material when specified by the manufacturer	60	140
6	On the subfloor top surface with floor finishing material removed	40	104

19.7.2 At least three adjacent joist spaces are to be heated simultaneously during the tests. The products under test are to be operated continuously, in accordance with the General Test Conditions described in Section 18, in a test ambient of  $20 \pm 2^{\circ}\text{C}$  ( $68 \pm 3.6^{\circ}\text{F}$ ), until thermal equilibrium is reached.

19.7.3 Maximum temperatures on the representative heating products and construction materials used to construct the test alcove ceiling, walls, and floor are to be determined. Ambient temperature variation below  $20^{\circ}\text{C}$  ( $68^{\circ}\text{F}$ ) is to be added to the measured temperature, and the resultant adjusted temperature used to determine compliance.


19.7.4 For a floor installation, including a common ceiling/floor section installation, the test is to be conducted both with and without the minimum R-11 floor finishing materials.

19.7.4 revised December 11, 1996

19.7.5 Temperatures of ceiling facing materials, thermal insulating material in direct contact with the representative heating products, and heating surfaces of the heating products are to be measured by means of fine wire thermocouples brazed to 0.3 mm (1/64 inch) thick circular or square copper plates having a nominal area of 177 mm<sup>2</sup> (0.3 inch<sup>2</sup>), as illustrated in Figure 19.4. Thermocouple leads are to be routed through small holes in the ceiling facing material to the interior of the test alcove. Each copper plate is to be secured in position so that it is flush and in full contact with both the heating product and the ceiling facing material.

19.7.6 Temperature measurements at locations other than those for determining product element and building material surface temperatures are to be made by means of fine wire thermocouples.

**Figure 19.4**  
**Temperature sensor**

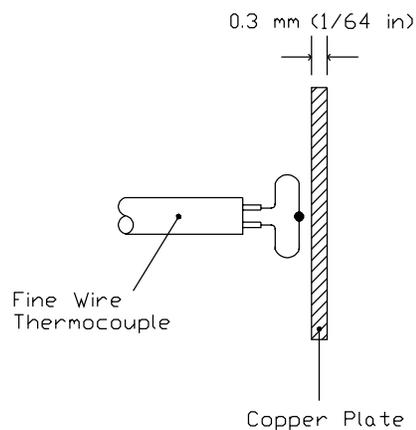

Notes:

- i) This figure illustrates the construction of a temperature sensor used for measurement of all product heating surface and facing material surface temperatures.
- ii) Temperatures of internal product components shall be made with fine wire thermocouples.

Not to Scale

SM953C

## 20 Abnormal Temperature Test

\*Section 20 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

### 20.1 Ceiling installation

20.1.1 A representative ceiling heating product installation is to be tested as described in 20.1.2, during which the maximum temperature shall not exceed 90°C (194°F). Upon completion of this test, there shall not be any evidence of cracking, deformation or delamination based on visual inspection.

20.1.2 Following the Normal Temperature Test, Section 19, one additional layer of 19.1 mm (3/4 inch) thick fir plywood is to be secured to the underside of the ceiling of the test alcove. The heating products are to be then operated in accordance with the test procedure of the Normal Temperature Test, described in 19.7, until thermal equilibrium is reached.

## 21 Contact Loss Test

\*Section 21 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

### 21.1 Parallel type heating products

21.1.1 Upon completion of this test, there shall not be any evidence of arcing or fire such as that indicated by severe discoloration, burning or charring of the cheesecloth.

21.1.2 A representative parallel type heating product is to be modified by the manufacturer to include an insulating shim between an internal nonheating bus conductor and the element so as to produce a loss of contact between the nonheating conductor and the heating material.

21.1.3 The insulating shim is to be one half the length of the nonheating conductor supplying one section of active element area, up to a maximum of 200 mm (8 inches). The insulator is inserted under only one of the internal bus conductors.

21.1.4 The insulating shim is to be as thin as practical while effectively breaking the contact between the nonheating conductor and the active heating area.

21.1.5 The heating product shall be compensated for maximum panel length and operated in accordance with the test procedure of the Normal Temperature Test, described in 19.7, with a single layer of cheesecloth placed over and under the representative heating product.

## FLEXIBLE HEATING PRODUCTS

### 22 Dielectric Voltage-Withstand Test (Dry)

\*Section 22 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

22.1 A representative flexible heating product is to be subjected to three complete cycles of the following conditioning sequence:

- a) Conditioned for 7 hours in an air circulating oven maintained at the maximum temperature observed during the Normal Temperature Test, Section 19;
- b) Cooled to room temperature, then energized at marked rated voltage (see 34.1(c)) for 1 hour; and
- c) Conditioned for 24 hours at  $20 \pm 2^{\circ}\text{C}$  ( $68 \pm 3.6^{\circ}\text{F}$ ) and a minimum of 96% relative humidity.

22.2 Following three complete conditioning cycles, there shall not be any evidence of delamination.

22.3 Immediately following the conditioning described in 22.1, the flexible heating product shall withstand for 1 minute without breakdown the application of a 40 – 70 Hz essentially sinusoidal potential between live parts and non-current-carrying metal parts. The test voltage is to be 1000 V plus twice the maximum rated voltage of the heating product.

22.4 The test voltage is to be applied between two metal foil electrodes connected together, and the supply terminals or leads of the product under test connected together. The foil electrodes are to be a maximum of 100- by 200-mm (4- by 8-inch) in overall dimension and are to be positioned on opposite sides of the heating product, in direct alignment with each other. The test electrodes are to be pressed against the heating product surface by means of a block of insulating material having a uniform thickness and a mass of 5 kg (11 lbs). Two 25 mm (1 inch) thick sponge rubber pads are to be interposed between the blocks and the foil electrodes.

22.5 The dielectric voltage is to be applied at locations chosen at random over the heating product surface, including bus bar locations and the ends of heating panel sets. When the test voltage is applied to the ends of a heating panel set, dielectric tape or other insulating material specified and/or provided by the manufacturer is to be used. The applied voltage is to be increased gradually at a uniform rate until the required test value is reached.

### 23 Dielectric Voltage-Withstand Test (In Water)

\*Section 23 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

23.1 A representative flexible heating product having a nominal length of 2 – 3 m (6-1/2 – 10 ft), is to be subjected to the conditioning described in 22.1.

23.2 Immediately following the conditioning described in 22.1, the flexible heating product is to be immersed at 500 mm (20 inches) maximum length increments, in a saline test solution having a maximum resistivity of 50 ohm-cm, with both ends of the heating product out of the water. The test voltage specified in 22.3 is to be applied between current-carrying parts of the heating product and the test solution for 1 minute. There shall be no dielectric breakdown. The test is to be repeated in increments over the entire length of the heating product excluding the ends.

## 24 Cold Bend Test

\*Section 24 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

24.1 Upon completion of the test described in 24.2, the heating product is to be examined for visual evidence of cracking, deformation or delamination and shall not break down when subjected to the Dielectric Voltage-Withstand Test procedure, excluding conditioning, described in 22.3 – 22.5.

24.2 The test procedure is to be performed as follows:

- a) A previously untested heating product is to be wrapped on a cylinder of cardboard or similar material with a diameter of 55 mm (2 inches) or of the minimum diameter used by the manufacturer for shipping the product, whichever is less;
- b) The wrapped heating product and cylinder is to be stored for 4 hours at  $-15 \pm 2^{\circ}\text{C}$  ( $5 \pm 3.6^{\circ}\text{F}$ ) or the minimum handling temperature specified by the manufacturer's instructions (see 36.2(m)), whichever is lower. At the end of the conditioning period, the heating product is then to be unwrapped and rewrapped in the reverse direction. This procedure is to be repeated six times within 30 minutes; and
- c) At the end of the forward and reverse wrapping procedure, the heating product is to be removed from the cold chamber and allowed to return to  $25 \pm 1^{\circ}\text{C}$  ( $77 \pm 1.8^{\circ}\text{F}$ ).

## 25 Mechanical Abuse Tests

\*Section 25 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

### 25.1 General

25.1.1 Upon completion of the conditioning described in 25.2, the heating product is to be examined for visual evidence of cracking, deformation or delamination and shall not break down when subjected to the Dielectric Voltage-Withstand Test procedure, excluding conditioning, described in 22.3 – 22.5.

25.1.2 The heating product is to then be installed in accordance with the instructions specified for the Normal Temperature Test, 19.3 – 19.5, with a single layer of cheesecloth placed above and below the heating product, and operated under the General Test Conditions, Section 18. Temperatures are to be measured using the temperature sensors constructed as shown in Figure 19.4, positioned along the location of element crease or flexing, and shall not exceed  $90^{\circ}\text{C}$  ( $194^{\circ}\text{F}$ ) on the heating product surface. The cheesecloth shall neither glow nor flame during the test.

## 25.2 Conditioning

25.2.1 The representative flexible heating product used for the Cold Bend Test, Section 24, is to be further conditioned for 4 hours at  $-15^{\circ} \pm 2^{\circ}\text{C}$  ( $+5 \pm 3.6^{\circ}\text{F}$ ) or the minimum handling temperature marked in the manufacturer's instructions (see 36.2(m)), whichever is lower, and is to be subjected to the mechanical abuse conditions described in 25.2.2 and 25.2.3.

25.2.2 Following the conditioning specified in 25.2.1, the representative flexible heating product is to be creased by positioning the heating product on a smooth flat surface, folding the heating product along a longitudinal axis, and applying a force of 900 N (202 lbf). The force is to be applied by means of a rigid test block positioned to contact the heating product over an area not less than a 100 mm x 100 mm (4 inches x 4 inches) adjacent to the line of the fold. The force is to be applied so that the block overlaps the fold and contacts the heating product over the prescribed area. The heating product is to be creased in two locations, the first along the midpoint of the product parallel to the longitudinal axis of symmetry; and the second, parallel to the same longitudinal axis, but within 15 mm (1/2 inch) of the edge of a nonheating conductor.

25.2.3 Following the cold crease conditioning described in 25.2.2, the representative flexible heating product is to be clamped between two 1 mm (3/64 inch) thick rectangular steel plates having smooth rounded edges. The two test plates are to be aligned, and are to be rigidly clamped within 3 mm (1/8 inch) of the plate edges. The heating product is to be positioned so that the longer edges of the plates are perpendicular to the longitudinal axis of the heating product. The heating product clamped between the plates is to be conditioned for 4 hours, at a temperature of  $-15 \pm 2^{\circ}\text{C}$  ( $+5 \pm 3.6^{\circ}\text{F}$ ) or minimum handling temperature marked in the manufacturer's instructions (see 36.2(m)), whichever is lower. At the end of the conditioning period, the free end of the heating product is to be bent back over the plates, in an alternating motion, as far as the construction of the clamps and plates permit, using an applied force of 50 N (11 lbf). The heating product is to be flexed for three complete cycles.

## 26 Scratch Test

Section 26 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products

26.1 After being conditioned as described in 26.2 – 26.4, a heating product shall not break down when subjected to the Dielectric Voltage-Withstand Test procedure, excluding conditioning, described in 22.3 – 22.5.

26.2 A square representative flexible heating product is to be conditioned until thermal equilibrium is reached at an ambient temperature of  $-15 \pm 2^{\circ}\text{C}$  ( $5 \pm 3.6^{\circ}\text{F}$ ) or the minimum handling temperature specified by the manufacturer's instructions (see 36.2(m)), whichever is lower. The heating unit, upon removal from the conditioning chamber, is then to be placed on a horizontal steel plate having a smooth surface.

26.2 revised December 11, 1996

26.3 The surface of the product is to be scratched by means of a hardened steel pin, the end of which has a form of a cone with a tip angle of 40°, its tip being rounded to a radius of  $0.25 \pm 0.02$  mm. Uniform scratches are to be made by drawing the pin along the surface of the heating product at a speed of about 20 mm/s (25/32 in/s). The pin is to be loaded so that the vertical force exerted by the tip of the pin on the heating product is  $10.0 \text{ N} \pm 0.5 \text{ N}$  for floor heating products and  $5.0 \text{ N} \pm 0.5 \text{ N}$  for ceiling heating products, with the pin oriented  $12.5 \pm 2.5$  degrees from the perpendicular in the direction of movement.

26.4 Five scratches are to be made on opposite plane surfaces of the product, one over a busbar (nonheating component), two parallel to the busbar at a distance of approximately 10 mm (25/64 inch) from the busbar in the active heating area, and two at right angles to the busbar from one edge to the other, at a distance of 10 mm (25/64 inch) from each other.

## 27 Concrete Slab Cracking Test

\*Section 27 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

27.1 When a flexible heating product, intended for installation in a concrete slab as described in 19.6.1 – 19.6.3, is tested as described in 27.2, it shall not permit a probe, as shown in Figure 7.1, to contact uninsulated live parts, or break down when subjected to the Dielectric Voltage-Withstand Test procedure, excluding conditioning, described in 22.3 – 22.5.

27.2 One end of the concrete slab is to be raised and a crack is to be created in the concrete by hitting the slab at the control joint with a sledge hammer. The separated concrete sections are to be farther separated until the heating product loses continuity at one of its nonheating conductors or the gap between the slabs exceeds 12.7 mm (1/2 inch). At this point, a salt water solution with a maximum resistivity of 50 ohm-cm is to be poured continuously into the crack. Finally, a conductive probe is to be placed into the solution in the crack, adjacent to but not touching the heating product, and connected to the source of dielectric voltage test potential.

## 28 Nonheating Conductor (Busbar) Overload Test

\*Section 28 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

### 28.1 Parallel type flexible heating products intended for feed through connection to other heating products

28.1.1 Upon completion of this test, there shall not be any evidence of arcing or fire such as that indicated by severe discoloration, burning or charring of the cheesecloth.

28.1.2 A parallel type heating product, of the marked maximum length (see 34.1(f)), is to be connected to a supply system of the nominal voltage on which the product is intended to be used, by means of the wire connectors and nonheating leads integral to the product or as specified by the product manufacturer. A single layer of cheesecloth is to be placed above and below the heating surface of the heating product and the nonheating conductors (busbars). An additional load is to be added to the heating product, at the end opposite to that at which the supply connections are made, and the total circuit current adjusted to 110% of the current rating of the branch circuit overcurrent protective device to which the product is intended to be connected. The test current is to be adjusted to maintain the 110% overload until a stable condition is observed.

## RIGID HEATING PRODUCTS

### 29 Dielectric Voltage-Withstand Test (Dry)

\*Section 29 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

29.1 A representative rigid heating product is to be subjected to three complete cycles of the following conditioning sequence:

- a) Conditioned for 7 hours in an air circulating oven maintained at the maximum temperature observed during the Normal Temperature Test, Section 19;
- b) Cooled to room temperature followed by 1 hour at  $-15 \pm 2^{\circ}\text{C}$  ( $+5 \pm 3.6^{\circ}\text{F}$ ) or the minimum handling temperature specified by the manufacturer's instructions (see 36.2(m)), whichever is lower;
- c) Returned to room temperature, energizing at marked rated voltage (see 34.1(c)) for 1 hour; and
- d) Conditioned for 24 hours at  $20 \pm 2^{\circ}\text{C}$  ( $68 \pm 3.6^{\circ}\text{F}$ ) and a minimum of 96% relative humidity.

29.2 Following three complete conditioning cycles, there shall not be any evidence of delamination.

29.3 Immediately following the conditioning described in 29.1, the rigid representative heating product shall withstand for 1 minute without breakdown the application of a 40 – 70 Hz essentially sinusoidal potential between live parts and non-current-carrying metal parts. The test voltage is to be 1000 V plus twice the maximum rated voltage of the heating product. For rigid heating products without non-current-carrying metal parts, the procedure outlined in 22.4 – 22.5 is to be followed.

### 30 Dielectric Voltage-Withstand Test (Water)

\*Section 30 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

30.1 A rigid heating product is to be subjected to the conditioning described in 29.1.

30.2 Following the conditioning described in 29.1, the rigid heating product is to be immersed in a saline test solution, having a maximum resistivity of 50 ohm-cm, for 30 minutes or until saturated. The heating product is to then be subjected to the Dielectric Voltage-Withstand Test (Dry) procedure, excluding conditioning, described in 29.3.

### 31 Impact Test

\*Section 31 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

31.1 A representative rigid heating product shall not develop openings or cracks that expose live parts as a result of the test described in 31.2 – 31.3. A probe as shown in Figure 7.1 shall not be permitted to contact uninsulated live parts. The Dielectric Voltage-Withstand Test procedure, excluding conditioning, described in 29.3 shall be repeated without breakdown, with electrodes placed in locations subject to mechanical abuse, when applicable.

31.2 A representative heating product is to be placed flat on a horizontal concrete surface and subjected to the following Impact Tests:

- a) A No. 2 Phillips screwdriver, 140 g (5 oz), dropped from a height of 2 m (6 ft-7 in), oriented so that the tip of the screwdriver will strike the product surface;
- b) A 500 g (1 lb) steel sphere, dropped from a height of 2 m (6 ft-7 in).

31.3 The tests are to be conducted on both plane surfaces of the heating product, and each test is to be conducted on a different area of the product surface.

### 32 Drop Test

\*Section 32 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

32.1 A representative rigid heating product shall not develop openings or cracks that expose live parts as a result of the test described in 32.2. A probe as shown in Figure 7.1 shall not be permitted to contact uninsulated live parts. The Dielectric Voltage-Withstand Test procedure, excluding conditioning, described in 29.3 shall be repeated without breakdown.

32.2 A representative heating product is to be temperature conditioned at  $-15 \pm 2^{\circ}\text{C}$  ( $+5 \pm 3.6^{\circ}\text{F}$ ) for 4 hours or minimum handling temperature marked in the manufacturer's instructions (see 36.2(m)), whichever is lower. The heating product is to be removed from this ambient and immediately raised to a height of 2 m (6 ft-7 in) above a cement floor, measured at the product's closest point to the floor, and released so as to strike the floor in the orientation most likely to result in damage to the heating product.

## MANUFACTURING AND PRODUCTION TESTS

### 33 Production-Line Dielectric Voltage-Withstand Test

\*Section 33 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

33.1 Each heating product shall withstand without electrical breakdown, as a routine production-line test, the application of a potential at a frequency within the range of 40 – 70 hertz:

- a) Between the primary wiring, including connected components, and accessible dead metal parts that are likely to become energized, and
- b) Between primary wiring and accessible low-voltage (42.4 volts peak or less) metal parts, including terminals.

*Exception: Production line dielectric voltage-withstand testing is not required if there are no accessible dead metal parts on the heating product.*

33.2 The production-line test shall be in accordance with either Condition A or Condition B of Table 33.1.

33.3 The heating product may be in a heated or unheated condition for the test.

33.4 The test shall be conducted when the heating product is complete (fully assembled). It is not intended that the heating product be unwired, modified, or disassembled for the test.

*Exception No. 1: A part such as a snap cover that would interfere with conducting the test need not be in place.*

*Exception No. 2: The test may be performed before final assembly if the test represents that for the completed heating product.*

33.5 The test equipment shall include a transformer having an essentially sinusoidal output, a means of indicating the test potential, an audible or visible indicator of electrical breakdown, and either a manual reset device to restore the equipment after electrical breakdown or an automatic reject feature activated by a dielectric breakdown.

33.6 If the output of the test equipment transformer is less than 500 volt-amperes, the equipment shall include a voltmeter in the output circuit to directly indicate the test potential.

**Table 33.1**  
**Production-line conditions**

Heater rating	Condition A		Condition B	
	Potential, Volts	Time, Seconds	Potential, Volts	Time, Seconds
0 – 600 volts	1000 +2V <sup>a</sup>	60	1200 +2.4V <sup>a</sup>	1

<sup>a</sup> Maximum marked voltage.

33.7 If the output of the test equipment transformer is 500 volt-amperes or larger, the test potential may be indicated by a voltmeter in the primary circuit or in a tertiary winding circuit, by a selector switch marked to indicate the test potential, or in the case of equipment having a single test-potential output, by a marking in a readily visible location to indicate the test potential. When marking is used without an indicating voltmeter, the equipment shall include a positive means, such as an indicator lamp, to indicate that the manual-reset switch has been reset following a dielectric breakdown.

33.8 Test equipment other than that described in 33.5 – 33.7 may be used if found to accomplish the intended factory control.

33.9 During the test, the primary switch is to be in the on position, both sides of the primary circuit of the heating product are to be connected together and to one terminal of the test equipment, and the second test-equipment terminal is to be connected to the accessible dead metal.

*Exception: A heating product (resistive, high-impedance winding, and the like) having circuitry not subjected to excessive secondary-voltage build-up in case of electrical breakdown during the test may be tested:*

- 1) *With a single-pole primary switch, if used, in the off position, or*
- 2) *With only one side of the primary circuit connected to the test equipment when the primary switch is in the on position, or when a primary switch is not used.*

## MARKINGS

### 34 Details

Section 34 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products

34.1 Each heating product shall be permanently marked with the following:

- a) The manufacturer's name, trade name, trademark, or other descriptive marking by which the organization responsible for the product may be identified;
- b) The product identification such as a catalog, style, model, or type designation;
- c) The rated voltage of the product, in accordance with 34.3;
- d) The letters "ac" after the voltage, or the symbol "~";
- e) For heating products of fixed dimension, the input in amperes or watts;
- f) For a heating product of dimensions determined during installation, the input (current or power) per unit area, based on the active area;
- g) For a heating product of dimensions determined during installation, the maximum heating panel length;
- h) The statement: "SEE INSTALLATION INSTRUCTIONS";
- i) As applicable, the following or equivalent statement, "RADIANT CEILING HEATING PANEL", "RADIANT FLOOR HEATING PANEL", or "RADIANT CONCRETE HEATING PANEL";

j) For products intended to be installed in a common joist space with a complementary radiant heating product, the following or equivalent statement, "INTENDED FOR INSTALLATION IN A COMMON JOIST SPACE WITH COMPLEMENTARY RADIANT HEATING PRODUCT RATED \_\_\_\_ MAXIMUM". The blank shall be filled in with the maximum heating density of the intended complementary heating product;

k) For each associate part required for installation of the heating product (connectors, insulating covers, crimping tools, insulating tape, etc.), a part number marked on the part or the part's smallest unit packaging;

l) The date or other dating period of manufacture not exceeding any three consecutive months

*Exception: The date of manufacture may be abbreviated or may be in a nationally accepted conventional code or in a code affirmed by the manufacturer, provided that the code:*

*a) Does not repeat in less than 20 years, and*

*b) Does not require reference to the production records of the manufacturer to determine when the product was manufactured; and*

m) For products intended to be installed in or beneath concrete, the following or equivalent statement, " INTENDED FOR CONCRETE INSTALLATION ONLY".

34.1 revised December 3, 1997

34.2 The markings required by 34.1 shall be visible during installation prior to application of panel finish on the outside of all heating products. The markings specified in (h), (i) and (j) shall be in letters not less than 2.4 mm (3/32 inch) high.

34.3 A heating product shall be marked with a voltage rating in accordance with any appropriate single voltage or range of voltages, such as 100 – 120, 208, 220 – 240, 254 – 277, 416, 440 – 480, 550, 575, and 600.

### 35 Warning Labels

Section 35 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products

35.1 The manufacturer of a heating product shall provide labels with provision for the installer to indicate which branch circuits supply the space heating installations and instructions that the labels, including those described in 35.2 – 35.4, shall be affixed to the panelboards. See 36.2(k).

*Exception: A heating product installation that is visible and distinguishable after installation need not be provided with labels.*

35.2 A warning label shall be supplied by the manufacturer of a ceiling heating product, marked with the word " WARNING", and the following or equivalent statement, " RISK OF ELECTRIC SHOCK – ELECTRIC WIRING AND HEATING PANELS CONTAINED IN CEILING. DO NOT PENETRATE CEILING WITH NAILS, SCREWS OR SIMILAR DEVICES ".

35.3 A warning label shall be supplied by the manufacturer of a below floor heating product, marked with the word "WARNING", and the following or equivalent statement, "RISK OF ELECTRIC SHOCK – ELECTRIC WIRING AND HEATING PANELS CONTAINED BELOW THE FLOOR. DO NOT PENETRATE FLOOR WITH NAILS, SCREWS, OR SIMILAR DEVICES".

35.4 A warning label shall be supplied with a ceiling heating product, marked with the word "WARNING", and the following or equivalent statement, "RISK OF FIRE. DO NOT INSTALL ADDITIONAL CEILING FACING MATERIALS ON EXISTING CEILING".

35.5 The manufacturer of a heating product shall provide labels that are intended to be affixed adjacent to points of access to concealed areas in which installed heating products are accessible. They shall be marked with the word "CAUTION", and the following or equivalent statement, "RADIANT HEATING PRODUCTS INSTALLED IN THIS AREA. AVOID ACTIONS WHICH MAY RESULT IN MECHANICAL DAMAGE TO THE PRODUCT." Each heating panel and each 100 m (328 ft) of heating panel sets shall be provided with one label. See 36.2(k).

*Exception: A heating product installation that is visible and distinguishable after installation need not be provided with labels.*

35.6 The markings described in 35.1 – 35.5 shall be in letters not less than 1.6 mm (1/16 inch) high except that the signal words "WARNING" and "CAUTION" shall be in letters not less than 2.4 mm (3/32 inch) high.

35.7 The manufacturer of a heating product shall provide labels that are intended to be affixed to individual room heating controls. They shall be marked with the following or equivalent term, "RADIANT CEILING HEATING" or "RADIANT FLOOR HEATING" as appropriate. The letter height is not specified. Each heating panel shall be provided with one label. Each 100 m (328 ft) of heating panel sets shall be provided with a minimum of five labels. See 36.2(k).

*Exception: A heating product installation that is visible and distinguishable after installation need not be provided with labels.*

## **INSTALLATION INSTRUCTIONS**

### **36 Details**

\*Section 36 effective August 18, 1995 for ceiling installed radiant heating products and February 16, 1996 for all other radiant heating products\*

36.1 Each heating product shall be provided with installation instructions by the manufacturer.

36.2 The instructions for installation shall include the following:

- a) Identification of the organization responsible for the product and the specific product or products covered by the instructions;
- b) The following or equivalent statement, "THIS EQUIPMENT SHALL BE INSTALLED ONLY BY QUALIFIED PERSONNEL WHO ARE FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE APPARATUS AND THE RISKS INVOLVED";

- c) The following or equivalent statement, "THE INSTALLATION OF THIS HEATING PRODUCT SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS AND THE REGULATIONS OF THE AUTHORITY HAVING JURISDICTION";
- d) The requirement that the installation shall be made in accordance with Article 424, Part J, of the National Electrical Code, ANSI/NFPA 70;
- e) Detailed information describing the intended product uses, limitations and methods of assembly of the heating product. The information is required to specify the installation location (floor, horizontal ceiling, sloped ceiling);
- f) Detailed information describing the intended electrical installation method including field wiring type, AWG size, and number of conductors per connection. The instructions for a heating product intended for connection of single conductor supply cable shall specify the type of cable to be used and state that "TYPE NM AND NMC NON-METALLIC SHEATHED CABLE IS NOT SUITABLE FOR INSTALLING THIS PRODUCT" or the equivalent;
- g) Details on installation in re-modeling applications if this is an intended use of the heating product. The details shall include instructions on reliably fastening the heating product in place. If modification of the heating product is necessary for such installation (for example, trimming non-heating selvage), specific instructions shall be provided on how the modification is to be accomplished along with specific information on modifications that are not acceptable;
- h) Information regarding associated parts required for on-site assembly and interconnection of heating products, including part numbers of the associated parts;
- i) Details of special tools and instructions for usage (see 10.5), and requirements for crimping tools if applicable;
- j) Detailed information describing limitations on, and installation of, thermal insulation and facing/finish materials. The information shall include the type, maximum thickness and/or thermal resistance rating of thermal insulating materials recommended by the manufacturer, the type(s) and characteristic(s) of materials not to be used in contact with the product, and the thickness and/or thermal resistance value not to be exceeded;
- k) Detailed instructions for affixing label(s), as required in 35.1, 35.5 and 35.7 to the service panelboard and other locations by the installer;
- l) Detailed information regarding wire routing, and the word "WARNING", and the following or equivalent statement, "RISK OF ELECTRIC SHOCK AND FIRE. DAMAGE TO SUPPLY CONDUCTOR INSULATION MAY OCCUR IF CONDUCTORS ARE ROUTED LESS THAN 2 INCHES (51 MM) FROM THIS HEATING PRODUCT. REFER TO INSTALLATION INSTRUCTIONS FOR RECOMMENDED MEANS OF ROUTING SUPPLY CONDUCTORS";
- m) Information regarding the minimum handling temperature of flexible heating products including any special precautions for installation; and
- n) The following or equivalent statement, "INTENDED FOR INSTALLATION IN HORIZONTAL CEILING CONSTRUCTIONS ONLY" for ceiling heating products.

*Exception: A heating product investigated for installation in sloped ceilings (see 19.2.1(a)) need not comply with this requirement.*

## APPENDIX A

### Standards for Components

Standards under which components of the products covered by this standard are judged include the following:

Title of Standard – UL Standard Designation

---

Flammability of Plastic Materials for Parts in Devices and Appliances, Tests for – 94

Polymeric Materials – Use in Electrical Equipment Evaluations – 746C

Wiring Terminals for Use With Aluminum and/or Copper Conductors, Equipment – 486E

No Text on This Page