



UL 870

Underwriters Laboratories Inc.
Standard for Safety

Wireways, Auxiliary Gutters,
and Associated Fittings



Underwriters Laboratories Inc. (UL)
333 Pfingsten Road
Northbrook, IL 60062-2096

UL Standard for Safety for Wireways, Auxiliary Gutters, and Associated Fittings, UL 870

Eighth Edition, Dated June 6, 2008

Summary of Topics

The new edition dated June 6, 2008 was issued to update the Title Page to indicate the latest approval date as an American National Standard and to include the proposals dated February 29, 2008. The following revisions were made:

- Requirements for nonmetallic wireways and wireways with environmental ratings were added.
- The Scope paragraph addressing investigation of new and different features of products was deleted.
- References were updated throughout the standard.

The new and revised requirements are substantially in accordance with UL's Proposal(s) on this subject dated February 29, 2008.

As indicated on the title page (page 1), this UL Standard for Safety is an American National Standard. Attention is directed to the note on the title page of this Standard outlining the procedures to be followed to retain the approved text of this ANSI/UL Standard.

As indicated on the title page (page1), this UL Standard for Safety has been adopted by the Department of Defense.

The UL Foreword is no longer located within the UL Standard. For information concerning the use and application of the requirements contained in this Standard, the current version of the UL Foreword is located on ULStandardsInfoNet at: <http://ulstandardsinonet.ul.com/ulforeword.html>

The master for this Standard at UL's Northbrook Office is the official document insofar as it relates to a UL service and the compliance of a product with respect to the requirements for that product and service, or if there are questions regarding the accuracy of this Standard.

UL's Standards for Safety are copyrighted by UL. Neither a printed copy of a Standard, nor the distribution diskette for a Standard-on-Diskette and the file for the Standard on the distribution diskette should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

Revisions of UL Standards for Safety are issued from time to time. A UL Standard for Safety is current only if it incorporates the most recently adopted revisions.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

UL will attempt to answer support requests concerning electronic versions of its Standards. However, this support service is offered on a reasonable efforts basis only, and UL may not be able to resolve every support request. UL supports the electronic versions of its Standards only if they are used under the conditions and operating systems for which it is intended. UL's support policies may change from time-to-time without notification.

UL reserves the right to change the format, presentation, file types and formats, delivery methods and formats, and the like of both its printed and electronic Standards without prior notice.

Purchasers of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgement (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

If a single-user version electronic Standard was purchased, one copy of this Standard may be stored on the hard disk of a single personal computer, or on a single LAN file-server or the permanent storage device of a multiple-user computer in such a manner that this Standard may only be accessed by one user at a time and for which there is no possibility of multiple concurrent access.

If a multiple-user version electronic Standard was purchased, one copy of the Standard may be stored on a single LAN file-server, or on the permanent storage device of a multiple-user computer, or on an Intranet server. The number of concurrent users shall not exceed the number of users authorized.

Electronic Standards are intended for on-line use, such as for viewing the requirements of a Standard, conducting a word search, and the like. Only one copy of the Standard may be printed from each single-user version of an electronic Standard. Only one copy of the Standard may be printed for each authorized user of a multiple-user version of an electronic Standard. Because of differences in the computer/software/printer setup used by UL and those of electronic Standards purchasers, the printed copy obtained by a purchaser may not look exactly like the on-line screen view or the printed Standard.

An employee of an organization purchasing a UL Standard can make a copy of the page or pages being viewed for their own fair and/or practical internal use.

The requirements in this Standard are now in effect, except for those paragraphs, sections, tables, figures, and/or other elements of the Standard having future effective dates as indicated in the note following the affected item. The prior text for requirements that have been revised and that have a future effective date are located after the Standard, and are preceded by a "SUPERSEDED REQUIREMENTS" notice.

New product submittals made prior to a specified future effective date will be judged under all of the requirements in this Standard including those requirements with a specified future effective date, unless the applicant specifically requests that the product be judged under the current requirements. However, if the applicant elects this option, it should be noted that compliance with all the requirements in this Standard will be required as a condition of continued Listing and Follow-Up Services after the effective date, and understanding of this should be signified in writing.

This Standard consists of pages dated as shown in the following checklist:

Page	Date
1-22	June 6, 2008

No Text on This Page

JUNE 6, 2008



ANSI/UL 870-2008

1

UL 870

Standard for Wireways, Auxiliary Gutters, and Associated Fittings

First Edition – October, 1943

Second Edition – July, 1968

Third Edition – May, 1973

Fourth Edition – August, 1977

Fifth Edition – June, 1985

Six Edition – January, 1991

Seventh Edition – June, 1995

Eighth Edition

June 6, 2008

The most recent designation of ANSI/UL 870 as an American National Standard (ANSI) occurred on June 6, 2008. The ANSI approval for this standard does not include the Cover Page, Transmittal Pages or Title Page.

This ANSI/UL Standard for Safety, which consists of the Eighth Edition, is under continuous maintenance, whereby each revision is ANSI approved upon publication.

The Department of Defense (DoD) has adopted UL 870 on April 14, 1987. The publication of revised pages or a new edition of this Standard will not invalidate the DoD adoption.

Revisions of this Standard will be made by issuing revised or additional pages bearing their date of issue. A UL Standard is current only if it incorporates the most recently adopted revisions, all of which are itemized on the transmittal notice that accompanies the latest set of revised requirements. Comments or proposals for revisions on any part of the Standard may be submitted to UL at any time. Proposals should be submitted via a Proposal Request in UL's On-Line Collaborative Standards Development System (CSDS) at <http://csds.ul.com>.

COPYRIGHT © 1977, 2008 UNDERWRITERS LABORATORIES INC.

No Text on This Page

CONTENTS

INTRODUCTION

1 Scope	4
2 Glossary	4
3 Units of Measurement	4
4 Undated References	4

CONSTRUCTION

5 General	5
6 Design	5
7 Conductor Size	6
8 Material	7
8.1 Metal wireways, auxiliary gutters, and associated fittings	7
8.2 Nonmetallic wireways, auxiliary gutters, and associated fittings	7
9 Thickness of Metal – Metal Wireways, Auxiliary Gutters, and Associated Fittings	8
10 Flanges and Reinforcing Strips – Metal Wireways, Auxiliary Gutters, and Associated Fittings	8
11 Openings in Enclosure – Metal Wireways, Auxiliary Gutters, and Associated Fittings	9
11.1 Connections for wiring systems	9
11.2 Other openings	10
12 Covers – Metal Wireways, Auxiliary Gutters, and Associated Fittings	10
13 Hinges and Latches – Metal Wireways, Auxiliary Gutters, and Associated Fittings	11
14 Expansion Joints and Telescoping Sections – Metal Wireways, Auxiliary Gutters, and Associated Fittings	11
15 Supports	13
15.1 General	13
15.2 Metal wireways	13
15.3 Nonmetallic wireways	13
16 Protection Against Corrosion – Metal Wireways, Auxiliary Gutters, and Associated Fittings	13
17 Raintight Wireways	15

PERFORMANCE

18 General	16
19 Electrical Continuity Test – Metal Wireways, Auxiliary Gutters, and Associated Fittings	16
20 Raintightness Test	16
20.1 General	16
20.2 Gaskets	19
21 Metallic Coating Thickness Test – Metal Wireways, Auxiliary Gutters, and Associated Fittings	19
22 Support Test	20
23 Ultraviolet Light Exposure – Nonmetallic Wireways, Auxiliary Gutters, and Associated Fittings	21

MARKING

24 General	21
25 Details	21

INTRODUCTION

1 Scope

1.1 These requirements cover wireways, auxiliary gutters, and associated fittings to be employed in accordance with the National Electrical Code, NFPA 70.

1.2 These requirements do not cover rigid or flexible conduit, surface raceways, underfloor raceways, nor other products of a similar nature that are covered by individual requirements.

2 Glossary

2.1 For the purpose of this standard the following definitions apply.

2.2 ASSOCIATED FITTING – A part that is used in the assembly of a complete wireway system, such as an elbow, tee, cross, end closer, or hanger.

2.3 AUXILIARY GUTTER – A section of wireway used to supplement the wiring space at a distribution center, switchboard, or similar location in a wiring system.

2.4 WIREWAY, METAL – A sheet-metal trough with a hinged or removable cover for housing and protecting electric wires and cables and in which conductors are laid in place after the wireway system has been installed as a complete system.

2.5 WIREWAY, NONMETALLIC – A flame-retardant, nonmetallic trough with removable covers for housing and protecting electric wires and cables in which conductors are laid in place after the wireway has been installed as a complete system.

3 Units of Measurement

3.1 If a value for measurement is followed by a value in other units in parentheses, the first stated value is the requirement. The second value may be only approximate.

4 Undated References

4.1 Any undated reference to a code or standard appearing in the requirements of this standard shall be interpreted as referring to the latest edition of that code or standard.

CONSTRUCTION

5 General

5.1 Construction requirements identified for wireways, auxiliary gutters and associated fittings apply to both nonmetallic and metal devices, unless specifically noted.

5.2 Wireways, auxiliary gutters, and associated fittings shall employ materials that are acceptable for the particular use, and shall be made and finished with the degree of uniformity and grade of workmanship practicable in a well-equipped factory.

5.3 A wireway system shall include all wireways and fittings required to make a complete installation in accordance with the National Electrical Code, ANSI/NFPA 70.

5.4 Unless otherwise noted, auxiliary gutters and fittings shall comply with all of the requirements for wireways.

5.5 Nonmetallic wireways, auxiliary gutters and fittings shall additionally comply with construction requirements in the Standard for Nonmetallic Surface Raceways and Fittings, UL 5A.

5.6 Wireways, auxiliary gutters and fittings marked for use with an environmental rating, including enclosure types, shall comply with the applicable requirements specified in the Standard for Enclosures for Electrical Equipment, Environmental Considerations, UL 50E.

6 Design

6.1 A metal wireway shall be constructed, such that the interconnection of sections and fittings will provide a rigid mechanical assembly and provide electrical conductivity complying with the requirements for the Electrical Continuity Test – Metal Wireways, Auxiliary Gutters, and Associated Fittings, Section 17.


6.2 A wireway shall be formed and assembled so that it will have the strength and rigidity necessary to resist the abuses to which it is likely to be subjected, without resulting in a risk of fire, electric shock, or injury to persons due to total or partial collapse with resulting damage to conductors, loosening or displacement of parts, or other serious defects.

6.3 The interior of the wireway shall be free from burrs and sharp corners or edges that may abrade the insulation on conductors or otherwise damage wiring. Screws and bolts, however used, shall not project into the wireway unless sharp ends and threaded sections are covered or otherwise prevented from coming in contact with wires.

Exception: A threaded section of a screw or bolt not having a sharp point need not be prevented from coming in contact with wires provided the screw or bolt does not project more than 1/32 in (0.8 mm) into the wireway.

6.4 A flatwise elbow or tee or a similar fitting for a wireway having a rectangular cross section shall be of the sweep type; that is, such a fitting for a right-angle bend shall have the internal corner replaced by a diagonal wall – see Figure 6.1 – to permit a larger bending radius for installed conductors. Sweep fittings may also be used in wireways of square cross section.

Figure 6.1
Flatwise sweep elbow

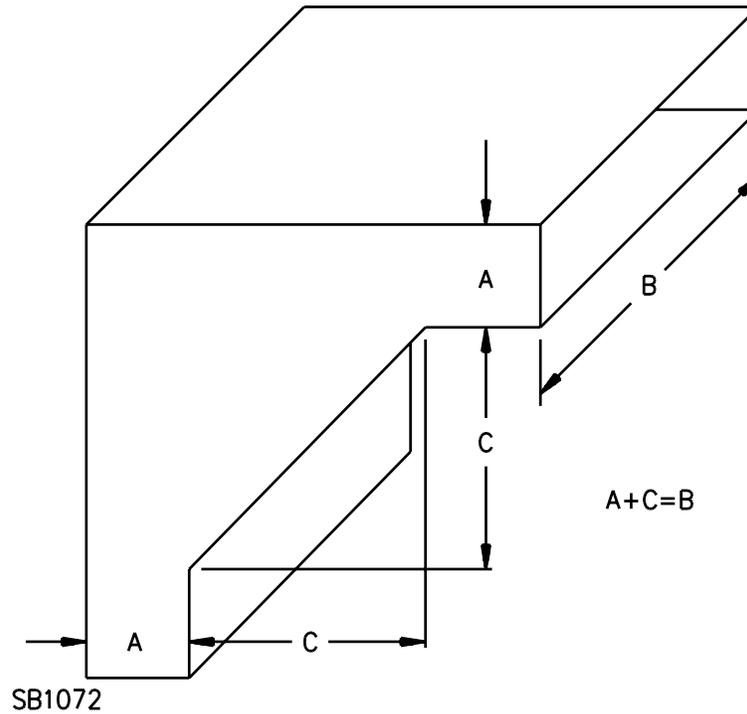

6.5 In a flatwise sweep fitting for a wireway of rectangular cross section, dimension A plus dimension C (the length of leg cut off by the diagonal wall) shall be equal to or exceed dimension B. See Figure 6.1.

6.6 For metal wireways, metal straps not less than 1/2-in (12.7-mm) wide and of the same thickness as the wireway, or metal rods not less than 1/4 inch (6.4 mm) in diameter may be provided at intervals across the width of the wireway to serve as wire-retaining means.

7 Conductor Size

7.1 The maximum conductor size for which a wireway is constructed is to be based on the bending space for conductors that enter or leave the wireway through connections in the sides or bottom in accordance with Table 7.1.

Table 7.1
Conductor size based on bending space

Smaller inside dimension of wireway ^a		Maximum conductor size	
in	(mm)	AWG or MCM	(mm ²)
2	(50.8)	3	(26.7)
2-1/2	(63.5)	2	(33.6)
3	(76.2)	1	(42.4)
3-1/2	(88.9)	2/0	(67.4)
4	(102)	4/0	(107.2)
4-1/2	(114)	250	(127)
5	(127)	350	(177)
6	(152)	500	(253)
8	(203)	900	(456)
10	(254)	1250	(633)
12	(305)	2000	(1013)

^a A minus tolerance of 1/8 in (3.2 mm) is allowed for manufacturing variations. The inside dimensions of the wireway are to be measured at a point where there is no fitting or fastening.

8 Material

8.1 Metal wireways, auxiliary gutters, and associated fittings

8.1.1 A wireway shall be of metal and shall be constructed to provide sufficient strength and rigidity so that the wireway will retain its shape and the covers will fit as intended.

8.1.2 In an auxiliary gutter, the use of insulating material to replace a portion of one wall of the auxiliary gutter where the wiring goes through meets the intent of the requirement in 8.1.1 when the insulating material and the assembly of the material to the auxiliary gutter supplies strength and rigidity equivalent to that of the auxiliary gutter without the substitution.

8.2 Nonmetallic wireways, auxiliary gutters, and associated fittings

8.2.1 The material used for nonmetallic wireways, auxiliary gutters, and associated fittings shall comply with the Standard for Nonmetallic Surface Raceways and Fittings, UL 5A.

8.2.2 In an auxiliary gutter, the use of insulating material to replace a portion of one wall of the auxiliary gutter where the wiring goes through meets the intent of the requirement in 8.2.1 when the insulating material and the assembly of the material to the auxiliary gutter supplies strength and rigidity equivalent to that of the auxiliary gutter without the substitution.

9 Thickness of Metal – Metal Wireways, Auxiliary Gutters, and Associated Fittings

9.1 A sheet-metal enclosure shall have a thickness not less than that specified in Table 9.1. If a metal other than steel, aluminum, or copper is used, it shall be of sufficient thickness to provide strength and rigidity equivalent to that of steel in the thickness specified.

Table 9.1
Minimum acceptable thickness of sheet metal

Maximum inside width of widest surface				Steel					
More than		Not more than or equal to		Uncoated		Galvanized ^a			
in	(mm)	in	(mm)	in	(mm)	in	(mm)	in	(mm)
0	(0)	6	(152)	0.053	(1.35)	0.056	(1.42)	0.075	(1.91)
6	(152)	12	(305)	0.060	(1.52)	0.063	(1.60)	0.095	(2.41)
12	(305)	18	(457)	0.067	(1.70)	0.070	(1.78)	0.095	(2.41)
18	(457)	30	(762)	0.093	(2.36)	0.097	(2.46)	0.122	(3.10)
30	(762)	–	–	0.123	(3.12)	0.126	(3.20)	0.153	(3.89)

^a See 16.8 for requirements for sheet steel that employs hot-dipped mill galvanized A60, G60, or G90 coatings.

10 Flanges and Reinforcing Strips – Metal Wireways, Auxiliary Gutters, and Associated Fittings

10.1 All seams, joints, or splices at a corner or a back edge of a wireway, or between abutting wireway sections or fittings shall be closed and reinforced by flanges formed of the material from which the wireway is made, or by separate strips, angles, or continuous welding so as to produce a construction substantially equivalent in strength to an integral flanged construction.

10.2 Reinforcing strips or angles shall have a thickness not less than that specified in Table 10.1.

Table 10.1
Minimum acceptable thickness of sheet metal for reinforcing strips or angles

Maximum inside width of widest surface				Steel					
More than		Not more than or equal to		Uncoated		Galvanized			
in	(mm)	in	(mm)	in	(mm)	in	(mm)	in	(mm)
0	(0)	6	(152)	0.043	(1.09)	0.047	(1.19)	0.060	(1.52)
6	(152)	18	(457)	0.054	(1.37)	0.058	(1.47)	0.077	(1.96)
18	(457)	30	(762)	0.068	(1.73)	0.071	(1.80)	0.098	(2.49)
30	(762)	–	–	0.097	(2.46)	0.100	(2.54)	0.124	(3.15)

10.3 A flange, separate strip, or angle shall overlap at least 1/2 in (12.7 mm), and shall extend approximately the full length of the seam, joint, or splice.

10.4 A flange, separate strip, or angle at a seam, joint, or splice between abutting wireway sections or between a wireway section and an attached fitting shall have fastenings located not more than 1-1/2 in (38.1 mm) from each end of the seam and at points not more than 6 in (152 mm) apart between these end fastenings.

Exception: A single fastening may be employed for a seam not more than 4-in (102-mm) long if it is located within 1/2 in (12.7 mm) of the center if in the bottom of the wireway, or between the center of the seam and the top if on the side of the wireway.

10.5 With reference to 10.4 and its exception, if separate strips are employed, fastenings shall be provided on both sides of the seam.

10.6 Rivets, spot-welds, bolts, and screws are considered to be acceptable forms of fastenings. See also 6.1 and 15.2.

10.7 At least two full threads shall be provided in metal into which screws are to be threaded. Fastenings in sheet metal shall have a diameter at least fifty percent greater than the thickness of the finished sheet metal with which they are used.

10.8 Sheet metal may be extruded at a tapped hole to provide at least two full threads, if the thickness of the metal before extrusion is not less than the pitch of a single thread.

11 Openings in Enclosure – Metal Wireways, Auxiliary Gutters, and Associated Fittings

11.1 Connections for wiring systems

11.1.1 An opening for connection of a wiring system in a wireway intended for stock and not for a particular installation shall be closed with a knockout, cover, or plug having a thickness not less than 0.053 in (1.35 mm) if of uncoated steel, 0.056 in (1.42 mm) if of galvanized steel, and no less than 0.077 in (1.96 mm) if of aluminum or copper. The knockout, cover, or plug shall be so secured in place that it can be readily removed but will not be displaced with ordinary handling. For a raintight wireway see 17.2.

11.1.2 A hole or a knockout shall be located so that adequate space will be provided for the installation of a locknut, a conduit bushing, an armored-cable connector, or other similar fitting.

11.2 Other openings

11.2.1 An open hole or a slot shall not be provided unless it will be closed in the final assembly and installation of the wireway.

Exception: See 17.2 and 17.3.

12 Covers – Metal Wireways, Auxiliary Gutters, and Associated Fittings

12.1 A cover shall be provided with means for securely holding it in place on the trough.

12.2 Fastenings for a flat or flanged cover shall comply with the requirements in 10.7 and 10.8 for screws and tapped holes or nuts, and with the requirements in 12.3 for other types of fastenings. The fastenings shall be located not more than 6 in (152 mm) from each end of the cover and spaced not more than 12 in (305 mm) apart at points between the end fastenings.

Exception: If the straps or rods mentioned in 6.6 are spaced not more than 30 in (762 mm) apart along the length of the wireway after assembly, a flat or flanged cover may be held by fastenings located not more than 6 in (152 mm) from each end of the cover and spaced not more than 24 in (160 mm) apart at points between these end fastenings.

12.3 A fastening device other than a tapped hole or nut may be employed with a screw. A type of fastening other than a screw may be employed if it is of adequate strength and is otherwise suitable for the application.

12.4 Unless a cover complies with the requirements in 12.5, a hinged or screw-on cover shall have flanges that overlap the side walls of the trough not less than 7/16 in (11.1 mm) throughout the full length of the cover. The ends of such a cover shall:

- a) Be flanged or otherwise formed to overlap the trough at least 1/2 in (12.7 mm),
- b) Provide a 1/4-in (6.4-mm) rabbet, or
- c) Employ a construction affording an equivalent closure of the trough.

12.5 A flat, unhinged cover may be used if:

- a) Each side wall of the trough is flanged at right angles to the wall to overlap the cover not less than 1/2 in (12.7 mm),
- b) Each end of the cover forms a 1/4-in (6.4-mm) rabbet with the adjoining cover, and
- c) The cover is fastened to the trough as required by 12.2.

13 Hinges and Latches – Metal Wireways, Auxiliary Gutters, and Associated Fittings

13.1 A hinge for a door or cover shall be of metal not less than 0.054-in (1.37-mm) thick if made of steel, and not less than 0.077-in (1.96-mm) thick if made of copper or aluminum.

Exception: A wireway cover may employ a continuous piano-type hinge made of steel not less than 0.047-in (1.2-mm) thick.

13.2 Hinges shall not be spaced more than 24 in (610 mm) apart, measured center to center, and not more than 15 in (381 mm) from each end of the cover. At least two hinges shall be used for each cover.

Exception: A single hinge that extends the full length of the cover may be used.

13.3 A hinged door or cover shall be provided with at least one latch or the equivalent for each 30 in (762 mm) or less of cover length. Latches shall not be located more than 12 in (305 mm) from each end of the cover and shall be evenly spaced not more than 36 in (914 mm) apart at points between the end latches.

13.4 Latches shall be positive in action.

13.5 A screw fastening is considered to be equivalent to a latch.

13.6 A button latch consisting of a projection stamped on the edge of the trough and engaging a corresponding indentation in the cover flange is not acceptable.

13.7 A spring latch consisting of a strip of steel fastened to the wall of a trough and cooperating with a slot in the cover shall be formed and attached so that the latch engages the edge of the cover slot away from the trough wall.

13.8 An arrangement of hinges or latches, or both, that does not fully comply with the requirements in 13.1 – 13.5, may be acceptable if, when subjected to an appropriate investigation, it is found to provide the necessary mechanical strength and rigidity of the complete assembly.

14 Expansion Joints and Telescoping Sections – Metal Wireways, Auxiliary Gutters, and Associated Fittings

14.1 An expansion joint or telescoping section shall have the necessary mechanical strength to support the conductors that may be installed in it and shall be provided with one or more bonding conductors to provide electrical continuity.

Exception: A telescoping section that can be made immovable at the time of installation by bolted fastenings equivalent to the fastenings required between straight lengths of wireway need not be provided with a bonding conductor.

14.2 The size of the bonding conductors, or the total cross section of the conductors if two or more are in parallel, shall be in compliance with Table 14.1.

Exception: A smaller conductor may be used if the expansion joint or telescoping section is marked to indicate a maximum circuit ampere rating for which the smaller conductor is adequate in accordance with Table 14.2. See 25.6.

Table 14.1
Full-size bonding conductor

Cross section of wireway				Minimum size of bonding conductor				Minimum cross section of bonding means			
More than		Not more than		Copper		Aluminum		Copper		EC aluminum	
in ²	(cm ²)	in ²	(cm ²)	AWG or MCM	(mm ²)	AWG or MCM	(mm ²)	in ²	(cm ²)	in ²	(cm ²)
–	–	4	(26)	3	(26.7)	1	(42.4)	0.041	(0.26)	0.068	(0.44)
4	(26)	6.25	(40.3)	1	(42.4)	2/0	(67.4)	0.068	(0.44)	0.104	(0.67)
6.25	(40.3)	9	(58)	1/0	(53.5)	3/0	(85.0)	0.083	(0.54)	0.138	(0.84)
9	(58)	11.11	(71.7)	2/0	(67.4)	4/0	(107.2)	0.104	(0.67)	0.166	(1.07)
11.11	(71.7)	20.25	(130.6)	4/0	(107.2)	350	(177)	0.166	(1.07)	0.274	(1.77)
20.25	(130.6)	25	(161)	350	(177)	500	(253)	0.274	(1.77)	0.393	(2.53)
25	(161)	36	(232)	400	(203)	600	(304)	0.314	(2.02)	0.471	(3.04)
36	(232)	64	(413)	700	(355)	1000	(507)	0.550	(3.55)	0.785	(5.06)
64	(413)	100	(645)	800	(405)	1200	(608)	0.628	(4.05)	0.942	(6.08)
100	(645)	144 ^a	(929)	800	(405)	1200	(608)	0.628	(4.05)	0.942	(6.08)

^a it is assumed no circuit rating will exceed 6000 A.

Table 14.2
Reduced-size bonding conductor

Maximum circuit ampere rating marked on wireway A	Minimum size of bonding conductor			
	Copper		Aluminum	
	AWG or MCM	(mm ²)	AWG or MCM	(mm ²)
15	14	(2.1)	12	(3.3)
20	12	(3.3)	10	(5.3)
30	10	(5.3)	8	(8.4)
40	10	(5.3)	8	(8.4)
60	10	(5.3)	8	(8.4)
100	8	(8.4)	6	(13.3)
200	6	(13.3)	4	(21.2)
400	3	(26.7)	1	(42.4)
600	1	(42.4)	2/0	(67.4)
800	1/0	(53.5)	3/0	(85.0)
1000	2/0	(67.4)	4/0	(107.2)
1200	3/0	(85.0)	250	(127)
1600	4/0	(107.2)	350	(177)
2000	250	(127)	400	(203)
2500	350	(177)	500	(253)
3000	400	(203)	600	(304)
4000	500	(253)	800	(405)
5000	700	(355)	1000	(507)
6000	800	(405)	1200	(608)

14.3 The connection of a bonding conductor shall have metal-to-metal contact with the enclosure over an area not less than the cross section of the conductor.

15 Supports

15.1 General

15.1.1 Fastening means for supports may consist of factory drilled holes in the enclosure for use with screws or bolts, or the wireway may be provided with instructions for drilling and spacing such holes (see 15.2.1) in the field, provided that the resulting construction will not result in any sharp corners or edges in the wireway. See 6.3.

15.2 Metal wireways

15.2.1 A metal wireway shall be provided with means for support at intervals not exceeding 5 ft (1.5 m) along its length.

Exception No. 1: The means for support (excluding auxiliary gutters) may be at intervals not exceeding 15 ft (4.6 m) if the wireway is intended for vertical installation.

Exception No. 2: The means for supporting a wireway (excluding auxiliary gutters) intended for horizontal installation may be at intervals exceeding 5 ft but not exceeding 10 ft (3.0 m), if the wireway complies with the Support Test, Section 22, and the wireway is marked in accordance with 25.7.

15.3 Nonmetallic wireways

15.3.1 A nonmetallic wireway shall be provided with means for support at intervals not exceeding 3 ft (900 mm) along its length.

Exception No. 1: The means for support (excluding auxiliary gutters) may be at intervals not exceeding 4 ft (1.2 m) if the wireway is intended for vertical installation.

Exception No. 2: The means for supporting a wireway (excluding auxiliary gutters) intended for horizontal installation may be at intervals exceeding 3 ft but not exceeding 10 ft (3.0 m), if the wireway complies with the Support Test, Section 22, and the wireway is marked in accordance with 25.7.

16 Protection Against Corrosion – Metal Wireways, Auxiliary Gutters, and Associated Fittings

16.1 Unless a wireway enclosure is made of metal that will resist corrosion, both inside and outside surfaces of the trough and the cover shall be protected against corrosion by enameling, galvanizing, plating, or other equivalent means.

16.2 For a wireway made of iron or steel, both inside and outside surfaces of each length of wireway shall be thoroughly cleaned of all scale and rust. The cleaning process shall leave the surface of the wireway in a condition such that the protective coating – see 16.1, 16.4, and 16.5 – will adhere firmly and have a smooth surface.

16.3 A hinge or other attachment of a raintight wireway shall be resistant to corrosion. Metals shall not be used in combinations as to cause galvanic action that will adversely affect any part of the wireway.

16.4 The enclosure of a raintight wireway shall be protected against corrosion by one of the following coatings:

- a) Hot-dipped mill-galvanized sheet steel conforming with the coating Designation G90 in the Weight [Mass] of Coating Requirements Table in the Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process, ASTM A653, with not less than 40% of the zinc on any side, based on the minimum single-spot test requirement in this ASTM designation. The weight of the zinc coating may be determined by any suitable method; however, in case of question, the weight of coating is to be established in accordance with the Test Method of the Standard Test Method for Weight [Mass] of Coating on Iron and Steel Articles with Zinc or Zinc-Alloy Coatings, ASTM A90. See 16.7 and 16.8.
- b) A zinc coating, other than that provided on hot-dipped mill-galvanized sheet steel, uniformly applied to an average thickness of not less than 0.00061 in (15.5 μm) on each surface with a minimum thickness of 0.00054 in (13.7 μm). The thickness of coating shall be established by the Metallic Coating Thickness Test – Metal Wireways, Auxiliary Gutters, and Associated Fittings, Section 21. An annealed coating shall comply with 16.5 and 16.6.
- c) A zinc coating conforming with item 1 or 2 below and with one coat of an organic finish of the epoxy or alkyd-resin type or other outdoor paint applied after forming on each surface. The suitability of the paint may be determined by consideration of its composition or by corrosion tests if these are considered necessary.
 - 1) Hot-dipped mill-galvanized sheet steel conforming with the coating Designation G60 or A60 in the Weight [Mass] of Coating Requirements Table in the Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process, ASTM A653, with not less than 40% of the zinc on any side, based on the minimum single-spot test requirement in this ASTM designation. The weight of zinc coating may be determined by any suitable method; however, in case of question the weight of coating is to be established in accordance with the Test Method of the Standard Test Method for Weight [Mass] of Coating on Iron and Steel Articles with Zinc or Zinc-Alloy Coatings, ASTM A90.
 - 2) A zinc coating, other than that provided on hot-dipped mill-galvanized sheet steel, uniformly applied to an average thickness of each surface with a minimum thickness of 0.00034 in (8.6 μm). The thickness of the coating shall be established in accordance with the Metallic Coating Thickness Test – Metal Wireways, Auxiliary Gutters, and Associated Fittings, Section 21.
- d) A cadmium coating not less than 0.0010 in (25 μm) thick on both surfaces. The thickness of coating shall be established in accordance with the Metallic Coating Thickness Test – Metal Wireways, Auxiliary Gutters, and Associated Fittings, Section 21.
- e) A cadmium coating not less than 0.00075-in (19.1- μm) thick on both surfaces with one coat of outdoor paint on both surfaces; or not less than 0.00051-in (13.0- μm) thick on both surfaces with two coats of outdoor paint on both surfaces. The thickness of the cadmium coating shall be established in accordance with the Metallic Coating Thickness Test – Metal Wireways, Auxiliary Gutters, and Associated Fittings, Section 21.
- f) Other finishes, including paints, metallic finishes, or combination of the two may be accepted when comparative tests with galvanized sheet steel – without annealing, wiping, or other surface treatment – conforming with (a), indicate they provide equivalent protection. Among the

factors that are taken into consideration when judging the suitability of such coating systems are exposure to salt spray, moist carbon dioxide-sulphur dioxide-air mixtures, moist hydrogen sulfide-air mixtures, ultraviolet light, and water.

16.5 An annealed coating on sheet steel that is bent or similarly formed or extruded or rolled at the edge of a hole after annealing shall be additionally painted in the affected area if the process damages the zinc coating.

16.6 If flaking or cracking of the zinc coating at the outside radius of the bent or formed section is visible at 25 power magnification, the zinc coating is considered to be damaged. Simple sheared or cut edges and punched holes are not required to be additionally protected.

16.7 A hot-dipped mill-galvanized A60, G60, or G90 coating shall not be damaged during handling or fabrication to the extent that the base steel is exposed.

Exception: Uncoated cross-section surfaces at cut edges and drilled openings are acceptable.

16.8 Sections of sheet steel that employ hot-dipped mill-galvanized A60, G60, or G90 coatings and formed, extruded, or rolled shall not be less than 90% of the minimum thickness specified in Table 9.1.

17 Raintight Wireways

17.1 A raintight wireway shall be constructed to exclude a beating rain.

17.2 A hole in the top, side, or back of a raintight wireway shall be suitable for use with an acceptable raintight hub.

17.3 There shall be provision for drainage of a raintight wireway.

Exception: Instructions for drilling holes in the field may be provided with a wireway. Such instructions shall indicate the proper positioning of the wireway.

17.4 A raintight wireway shall be provided with external fastening means for mounting.

Exception: A wireway may be provided with internal fastening means for mounting if the resulting construction prevents water from entering the enclosure.

PERFORMANCE

18 General

18.1 Performance requirements identified for wireways, auxiliary gutters and associated fittings apply to both nonmetallic and metal devices, unless specifically noted.

18.2 Nonmetallic wireways, auxiliary gutters and fittings shall additionally comply with performance requirements in the Standard for Nonmetallic Surface Raceways and Fittings, UL 5A.

19 Electrical Continuity Test – Metal Wireways, Auxiliary Gutters, and Associated Fittings

19.1 The resistance of the connection between adjacent sections of wireway or auxiliary gutter, and the connection between a wireway or auxiliary gutter and a fitting shall not be more than 0.005 Ω .

19.2 The wireway or gutter and fittings are to be installed in the intended manner. A direct current of 30 A is then to be passed between adjacent sections of wireway or gutter, and between the wireway or gutter and the fitting. The resulting voltage drop is to be measured between a point (file mark) on the wireway 1/16 in (1.6 mm) from the connection and a similar point on the far end of an adjacent wireway or on the fitting, if of the ending-fitting type. In the case of a fitting of the feed-through type, the resulting drop in potential is to be measured between points on the two adjacent pieces of wireway or gutter 1/16 in (1.6 mm) from the connections. The resistance in ohms is to be determined by dividing the drop in potential in volts by the current in amperes passing through the raceway.



20 Raintightness Test

20.1 General


20.1.1 To determine if a raintight wireway complies with the requirement in 17.1, two sections of the wireway are to be assembled in the intended manner if the wireway is designed to be so assembled; otherwise, the test is to be performed on a single section. Conduit connections, without pipe-thread compound, are to be as in actual service. When a water spray as described in 20.1.2 is applied to the wireway for 1 h, there shall be no entrance of water.

20.1.2 The water spray test apparatus is to consist of three spray heads mounted in a water supply pipe rack as shown in Figure 20.1. The spray heads are to be constructed in accordance with the details shown in Figure 20.2. The water pressure for all tests is to be maintained at 5 psi (34 kPa) at each spray head. The distance between the center nozzle and the unit is to be approximately 5 ft (1.5 m). The wireway is to be brought into the focal area of the three spray heads in such a position and under such conditions that are most likely to result in entrance of water into the wireway. The spray is to be directed at an angle of 45° to the vertical toward the joints and openings of the wireway.

Figure 20.1
Rain-test spray-head piping
PLAN VIEW

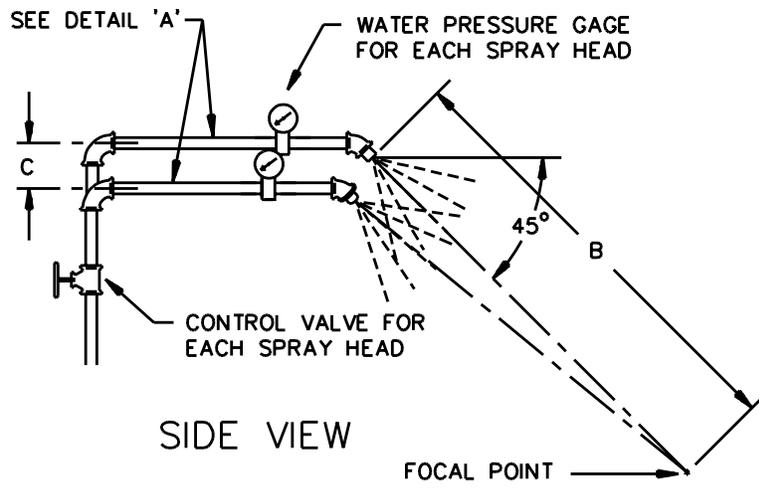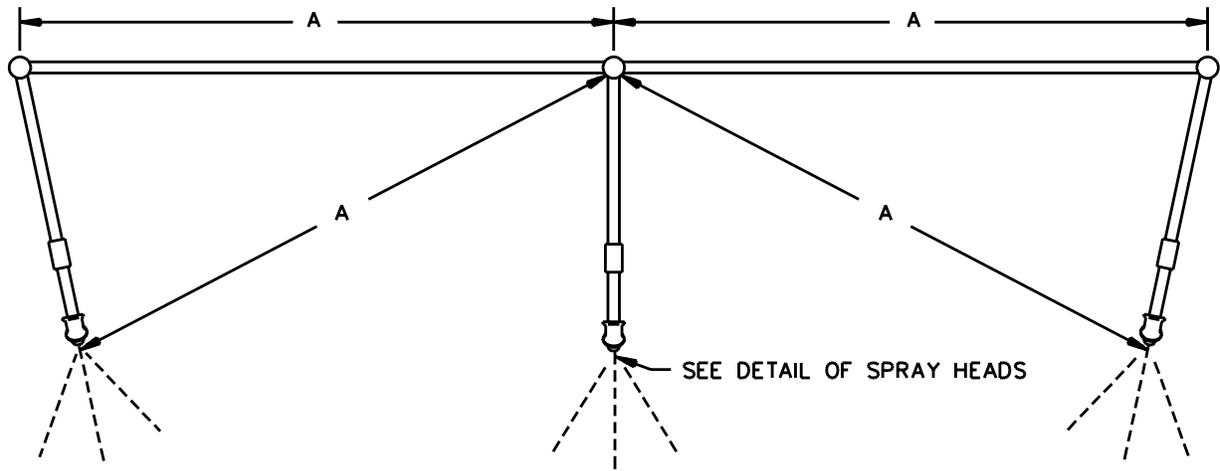

PIEZOMETER ASSEMBLY
DETAIL 'A'

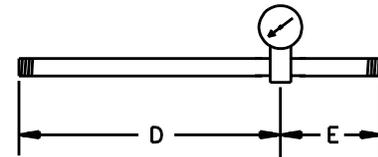


Item	inch	mm
A	28	710
B	55	1400
C	2-1/4	55
D	9	230
E	3	75

RT101E

Figure 20.2
Rain-test spray head

ASSEMBLY^a

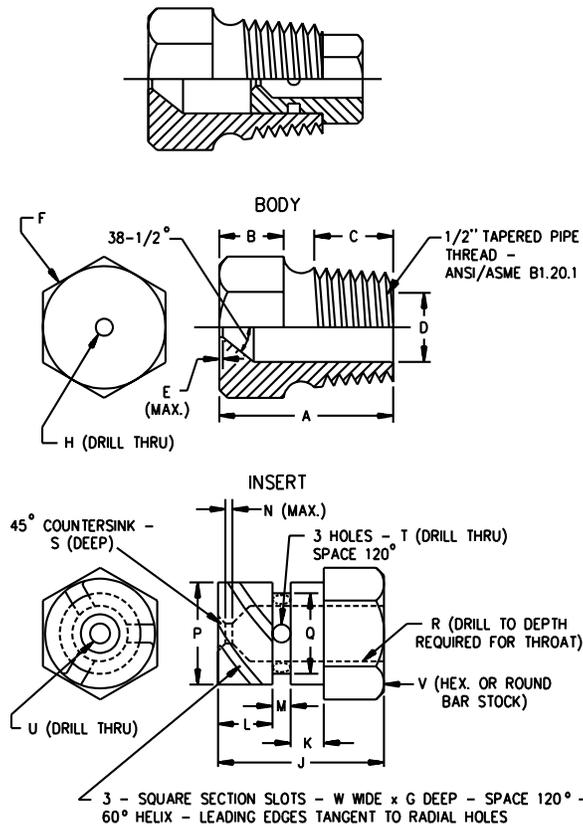

RT100C

Item	in	(mm)	Item	in	(mm)
A	1-7/32	(31.0)	N	1/32	(0.80)
B	7/16	(11.0)	P	.575	(14.61)
C	9/16	(14.0)	Q	.576	(14.63)
D	.578	(14.68)	R	.453	(11.51)
E	.580	(14.73)	S	.454	(11.53)
F	1/64	(0.40)	T	1/4	(6.35)
G	c	c	U	1/32	(0.80)
H	(No. 9) ^b	(5.0)	V	(No. 35) ^b	(2.80)
J	23/32	(18.3)	W	(No. 40) ^b	(2.50)
K	5/32	(3.97)		5/8	(16.0)
L	1/4	(6.35)		0.06	(1.52)
M	3/32	2.38			

^a Nylon Rain – Test Spray Heads are available from Underwriters Laboratories Inc.

^b ANSI B94.11M Drill size.

^c Optional – To serve as wrench grip.

20.2 Gaskets

20.2.1 After exposure to a temperature of 156 – 158°F (69 – 70°C) in an air-circulating oven for 168 h, a gasket of rubber or rubberlike material provided with a raintight wireway shall have a tensile strength not less than 75% and an elongation not less than 60% of the corresponding values of unaged samples.

21 Metallic Coating Thickness Test – Metal Wireways, Auxiliary Gutters, and Associated Fittings

21.1 The method of determining the thickness of a zinc or cadmium coating by the metallic coating thickness test is described in 21.2 – 21.9. The aforementioned applies only if the required thickness is specified.

21.2 The solution to be used for the test is to be made from distilled water and is to contain 200 g/L of reagent grade chromic acid (CrO_3) and 50 g/L of reagent grade concentrated sulfuric acid (H_2SO_4). The latter is equivalent to 27 mL/L of reagent grade concentrated sulfuric acid, specific gravity 1.84, containing 96% of H_2SO_4 .

21.3 The test solution is to be contained in a glass vessel such as a separatory funnel with the outlet equipped with a stopcock and a capillary tube of approximately 0.025 in (0.64 mm) inside bore and 5.5-in (140-mm) long. The lower end of the capillary tube is to be tapered to form a tip, the drops from which are about 0.05 mL each. To preserve an effectively constant level, a small glass tube is inserted in the top of the funnel through a rubber stopper and its position is to be adjusted so that when the stopcock is open, the rate of dropping is 100 ± 5 drops per minute. If desired, an additional stopcock may be used in place of the glass tube to control the rate of dropping.

21.4 The sample and the test solution are to be kept in the test room long enough to acquire the temperature of the room, which is to be noted and recorded. The test is to be conducted at a room temperature of 70 – 90°F (21 – 32°C).

21.5 Each sample is to be thoroughly cleaned before testing. All grease, lacquer, paint, and other nonmetallic coatings are to be removed completely by means of suitable solvents. Samples are then to be thoroughly rinsed in water and dried with clean cheesecloth. Care should be exercised to avoid contact of the cleaned surface with the hands or any foreign material.

21.6 The sample to be tested is to be supported from 0.7 – 1 in (17.8 – 25.4 mm) below the orifice, so that the drops of solution strike the point to be tested and run off quickly. The surface to be tested should be inclined about 45° from horizontal.

21.7 After cleaning, the sample to be tested is to be put in place under the orifice. The stopcock is to be opened and the time in seconds is to be measured with a stop watch until the dropping solution dissolves the protective metal coating, exposing the base metal. The end point is the first appearance of the base metal recognizable by the change in color at that point.

21.8 Each sample of a test lot is to be subjected to the test at three or more points, excluding cut, stenciled, and threaded surfaces, on the inside surface and at an equal number of points on the outside surface at places where the metal coating may be expected to be the thinnest. On enclosures made from precoated sheets, the external corners that are subjected to the greatest deformation are likely to have thin coatings.

21.9 To calculate the thickness of the coating being tested, select from Table 21.1 the thickness factor appropriate for the temperature at which the test was conducted and multiply by the time in seconds required to expose base metal as noted in 21.7.

Table 21.1
Coating thickness factors

Temperature		Thickness factors, 0.00001 in (0.0003 mm) per second	
°F	(°C)	Cadmium platings	Zinc platings
70	(21.1)	1.331	0.980
71	(21.7)	1.340	0.990
72	(22.2)	1.352	1.000
73	(22.8)	1.362	1.010
74	(23.3)	1.372	1.015
75	(23.9)	1.383	1.025
76	(24.4)	1.395	1.033
77	(25.0)	1.405	1.042
78	(25.6)	1.416	1.050
79	(26.1)	1.427	1.060
80	(26.7)	1.438	1.070
81	(27.2)	1.450	1.080
82	(27.8)	1.460	1.085
83	(28.3)	1.470	1.095
84	(28.9)	1.480	1.100
85	(29.4)	1.490	1.110
86	(30.0)	1.501	1.120
87	(30.6)	1.513	1.130
88	(31.1)	1.524	1.141
89	(31.7)	1.534	1.150
90	(32.2)	1.546	1.160

22 Support Test

22.1 A wireway as mentioned in Exception No. 2 to 15.1 shall be tested as described in 22.2 without rupture or permanent distortion.

22.2 A wireway is to be supported as specified by the manufacturer with the supports spaced at the maximum interval for which the wireway is marked. A load as determined by the following equation is to be applied midway between the supports, and is to be maintained for 1 min.

$$W = 0.064 (AL)$$

In which:

W is the load to be applied in pounds.

A is the inside cross-sectional area of the wireway in square inches.

L is the distance between supports in inches.

If the wireway is intended to be supported at points other than the joints, two sections of wireway sufficient length are to be joined and supported as intended with the joint midway between the supports, and the load is to be applied at the joint.

23 Ultraviolet Light Exposure – Nonmetallic Wireways, Auxiliary Gutters, and Associated Fittings

23.1 A nonmetallic wireway, auxiliary gutter, or associated fitting that is rated "Sunlight Resistant" shall be investigated in accordance with the applicable requirements of the Standard for Polymeric Materials – Use in Electrical Equipment Evaluations, UL 746C.

MARKING

24 General

24.1 Marking requirements identified for wireways, auxiliary gutters and associated fittings apply to both nonmetallic and metal devices, unless specifically noted.

25 Details

25.1 Each length of wireway or auxiliary gutter and each fitting shall be plainly marked where it will be visible after installation, with the manufacturer's name, trademark, or other descriptive marking by which the organization responsible for the product may be identified – hereinafter referred to as the manufacturer's name.

25.2 A raintight wireway shall be marked "Raintight " in such a location on the enclosure that the marking will be conspicuous. If this marking is applied to the wireway on an individual nameplate, label, or the like, the manufacturer's name shall be included on the nameplate or the like.

25.3 A raintight wireway having an opening in the top or in a side shall be marked to indicate the hub or hubs and the cover plate or plates that have been found to be suitable for use with the wireway unless such components are factory-installed.

25.4 A raintight wireway provided with drain holes shall be marked "Install with drain holes down," or the equivalent, to clearly indicate the mounting position necessary for adequate drainage.

25.5 A nonmetallic wireway evaluated as being sunlight resistant shall be marked "Sunlight Resistant" in such a location on the enclosure that the marking will be conspicuous. If this marking is applied to the wireway on an individual nameplate, label, or the like, the manufacturer's name shall be included on the nameplate or the like.

25.6 Each length of wireway shall be marked to indicate the maximum size of conductor for which it is designed as follows: "Maximum conductor size ____AWG (or MCM)."

Exception: Conductors that enter only at the ends of the run are limited in size only by the 20% fill requirements of the National Electrical Code, NFPA 70. The conductor size specified in the marking shall be in compliance with Table 7.1.

25.7 A metal expansion joint or telescoping section with a reduced-size bonding conductor in compliance with the Exception to 14.2, shall be marked with the circuit ampere rating for which it is acceptable.

25.8 Each length of metal wireway intended for horizontal installation with supports at intervals exceeding 5 ft (1.5 m) but not exceeding 10 ft (3.0 m) in accordance with Exception No. 2 to 15.2.1 shall be marked to indicate the maximum acceptable support interval for the wireway.

25.9 Each length of nonmetallic wireway intended for horizontal installation with supports at intervals exceeding 3 ft (900 mm) but not exceeding 10 ft (3.0 m) in accordance with Exception No. 2 to 15.3.1 shall be marked to indicate the maximum acceptable support interval for the wireway.

25.10 Each length of wireway or auxiliary gutter and each fitting shall be marked with a type number indicating the external conditions specified in the Standard for Enclosures for Electrical Equipment, Environmental Considerations, UL 50E, for which it is acceptable. A device that complies with the requirements for more than one type of enclosure may have multiple designations. The marking shall be plainly marked where it will be visible after installation.

Exception: Devices rated "Type 1" are not required to be provided with a type number.

25.11 Devices marked with a type designation may also be marked with other descriptive designators as identified in the Standard for Enclosures for Electrical Equipment, Environmental Considerations, UL 50E.